



Vertical Stack

Cabinet Nomenclature	1
Chassis Nomenclature	5
AHRI Performance Rating	8
Features & Benefits	9
Whispertherm® Thermostats	12
Unit Protection & LED Fault Status	13
Multi-protocol DDC Controller	14
Physical Data Table	15
Unit Voltage / Operating Limits	16
Whispertherm® 2-Row Performance Data	17
Whispertherm® 3-Row Performance Data	18
Airflow Performance Tables	20
Performance Data Correction Factors	21
Whispertherm® Standard Riser & TRU Details	34
Whispertherm® Extended Riser & TRU Details	35
Whispertherm® Split Riser & TRU Details	36
Whispertherm® TRU Connection Locations	37
Whispertherm® Cabinet Drawings	39
Whispertherm® Warranty Statements	52
Revision Table	56





Category	Position	Option Digit and Description	
Product Family	1	V =	Vertical Stack Water Source Heat Pump
Product Type	2	T =	Whisper Series Integrated Thermal Recovery Unit (Enthalpy Core)
		N =	Whisper Series Integrated Thermal Recovery Unit (Sensible Core)
System Configuration	3	A =	Heat Pump
		C =	Air Conditioning and Hydronic Heat
Unit Capacity / Heat Exchanger	4,5,6	020 =	0.50-ton
		030 =	0.75-ton
		040 =	1.00-ton
		050 =	1.25-ton
		060 =	1.50-ton
		080 =	2.00-ton Standard Performance
		081 =	2.00-ton Enhanced Performance
		100 =	2.50-ton
Revision (Major)	7	120 =	3.00-ton
		4 =	4th Generation
Unit Voltage	8	F =	Dual Point Power: 208/230-60-1 Unit with 115-60-1 TRU Module
		H =	Dual Point Power: 265-60-1 Unit with 115-60-1 TRU Module
Fan	9	D =	ECM - Constant Torque Motor (Size 080 - 120)
		G =	ECM - Constant Torque Motor (Sizes 020 - 060)
Revision (Minor)	10	B =	Revision B
		C =	Revision C
		D =	Revision D
Sound Attenuation	11	A =	Standard Quiet Construction
		D =	Standard Quiet Construction with Silver Rail Isolation
		E =	Standard Quiet Construction with Silver Rail Isolation & Vibration Isolation Pad
		F =	Standard Quiet Construction with Vibration Isolation Pad
Cabinet Type	12	B =	84 inch tall - Galvanized
		G =	84 inch tall - Paint Grip
		S =	84 inch tall with Factory Mounted Cabinet Stand
		L =	93 inch tall - Galvanized
		M =	93 inch tall - Paint Grip
		N =	93 inch tall with Factory Mounted Cabinet Stand
		Z =	Special customer defined cabinet height - (Special Engineering Request is required)

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Cabinet Nomenclature

Category	Position	Option Digit and Description	
Ventilation	13	1 =	35 CFM (constant) / 150 CFM (intermittent with accessory switch) TRU Ventilation Rate
		2 =	50 CFM (constant) / 150 CFM (intermittent with accessory switch) TRU Ventilation Rate
		3 =	70 CFM (constant) / 150 CFM (intermittent with accessory switch) TRU Ventilation Rate
		4 =	90 CFM (constant) / 150 CFM (intermittent with accessory switch) TRU Ventilation Rate
		5 =	25 CFM (constant) / 100 CFM (intermittent with accessory switch) TRU Ventilation Rate
		6 =	35 CFM (constant) / 100 CFM (intermittent with accessory switch) TRU Ventilation Rate
		7 =	50 CFM (constant) / 100 CFM (intermittent with accessory switch) TRU Ventilation Rate
		8 =	70 CFM (constant) / 100 CFM (intermittent with accessory switch) TRU Ventilation Rate
TRU Voltage	14	A =	TRU Voltage: 115-60-1
Fan Control	15	A =	Fan wiring - Single speed
		B =	Fan wiring - Single speed with 2-speed fan switch
		D =	Fan wiring - Single speed with Ultra-low airflow
		E =	Fan wiring - Single speed with Ultra-low airflow and 2-speed fan switch
		F =	F - Fan wiring - Two speed
		G =	G - Fan wiring - Two speed with Ultra-low airflow
		K =	DDC Wall Sensor
		Z =	Special fan control wiring scheme - (Special Engineering Request is required)
Supply Air Discharge	16	1 =	1 Supply Air Outlet
		2 =	2 Supply Air Outlets
		3 =	3 Supply Air Outlets
		P =	Knockout - all sides
		Z =	Special Supply Air Discharge Configuration - (Special Engineering Request is required)
Cabinet Protection	17	X =	None
		A =	Return Air Opening Cover
		B =	All Supply Air Openings Covered
		C =	All Supply & Return Air Opening Cover
		D =	All Openings Shrink Wrapped
Power Termination / Entry Location	18	X =	None
		A =	Side Entry - With Unfused unit disconnect
		B =	Side Entry - With Unit circuit breaker (Fused disconnect)

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Category	Position	Option Digit and Description	
Thermostat Extension	19	B =	T-stat Extension w/plug for offset mounting - 5 ft
		C =	T-stat Extension w/plug for offset mounting - 10 ft
		D =	T-stat Extension w/plug for offset mounting - 20 ft
		E =	T-stat Extension w/plug for offset mounting - 30 ft
		F =	T-stat Extension w/plug for offset mounting - 40 ft
		G =	T-stat Extension w/plug for offset mounting - 50 ft
		P =	Panel Mount Thermostat / Wall Sensor
		3 =	Factory Wired Remote Thermostat (Secondary Unit) - Right Side
		4 =	Factory Wired Remote Thermostat (Secondary Unit) - Left Side
		7 =	Factory Wired Remote Thermostat - Right Side
		8 =	Factory Wired Remote Thermostat - Left Side
Control Type	20	Y =	Special T-stat Extension w/plug length
		Z =	Special Thermostat Location
Water Temperature Sensors	21	A =	Solid State Control
		A =	32°F Freeze Protection with 36°F Low/High Liquid Temp setting
		E =	32°F Freeze Protection with 125°F Low/High Liquid Temp setting
		G =	20°F Freeze Protection with 20°F Low/High Liquid Temp setting
		N =	10°F Freeze Protection with 10°F Low/High Liquid Temp setting
DDC Control	22	P =	10°F Freeze Protection with 0°F Low/High Liquid Temp setting
		X =	No DDC control package installed
		A =	Whalen DDC Control (IO Zone 560) with current switch
		B =	Whalen DDC Control (IO Zone 560) no current switch
		C =	Customer supplied: DDC Controller - No sensors or fan speeds
		E =	IO Zone 560 DDC Control with Fan & Compressor status current switch
		F =	IO Zone 560 DDC Control with Discharge Air Temperature
		G =	IO Zone 560 DDC Control with Fault Alarm
		H =	IO Zone 560 DDC Control with Fan & Compressor status current switch with Discharge Air Temperature
		J =	IO Zone 560 DDC Control with Fan & Compressor status current switch with Fault Alarm
		K =	IO Zone 560 DDC Control with Fan & Compressor status current switch, Discharge Air Temperature, and Fault
Drain Pan Options	23	L =	IO Zone 560 DDC Control with Discharge Air Temperature & Fault Alarm
		Z =	Special DDC Control - (Special Engineering Request is required)
Insulation Option	24	A =	Standard Stainless Steel
		B =	Standard Stainless Steel with Condensate Pump
TRU Air Duct Connections	25	A =	Fiberglass
		B =	Foil Face Insulation - Entire Unit
		C =	Closed Cell Insulation - Entire Unit
		D =	Fiberglass Top of Unit - 1" in lieu of 1/2"
		1 =	Top Connections

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Cabinet Nomenclature

Category	Position	Option Digit and Description	
Filtration	26	X =	Field installed
		A =	1" MERV 4 Throwaway
		B =	1" MERV 8 Throwaway
		C =	1" MERV 11 Throwaway
		D =	1" MERV 13 Throwaway
		E =	2" MERV 4 Throwaway
		F =	2" MERV 8 Throwaway
		G =	2" MERV 11 Throwaway
		H =	2" MERV 13 Throwaway
Riser Style	27	J =	Aluminum
		A =	Factory Supplied / Unit mounted risers with riser cover (Risers configured separate)
		B =	Factory Supplied / Unit mounted risers without riser cover (Risers configured separate)
		C =	Factory Supplied / Unit mounted primary riser with riser cover (Risers configured separate)
		D =	Factory Supplied / Unit mounted primary riser without riser cover (Risers configured separate)
		E =	Factory Supplied / Unit mounted secondary riser with condensate riser (Risers configured separate)
		F =	Factory Supplied / Shipped Separate - Chassis Shipped in Cabinet (Risers configured separate)
		M =	Factory Supplied / Shipped Separate (Risers configured separate)
		Q =	Factory Supplied / Shipped Separate - Knockouts - all sides (Risers configured separate)
		R =	Field Supplied Risers - Chassis Shipped in Cabinet
		S =	Field Supplied Risers - Knockouts - all sides
Riser Spacing	28	X=	Field Supplied Risers / None / Secondary unit with no risers or condensate
		Z =	Special Riser Configuration - (Special Engineering Request is required)
		A =	Standard Spacing
		S =	Bulls-Eye Stand-off for Cast-in Firestop Device - Up to 2" Max Riser
		T =	Bulls-Eye Stand-off for Cast-in Firestop Device - 3" Max Riser
		U =	Bulls-Eye Stand-off for Cast-in Firestop Device - 4" Max Riser
Riser Location	29	Z =	Special Riser Spacing / Configuration - (Special Engineering Request is required)
		1 =	Factory Supplied - Unit mounted risers
		2 =	Factory Supplied - Shipped Separate
		X =	None / Field Supplied Risers
Special Configuration	30	Z =	Special Riser Location - (Special Engineering Request is required)
		X =	None

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Category	Position	Option Digit and Description	
Brand	1	W =	Whalen
Product Family	2-3	VP =	Vertical Stack Water Source Heat Pump - 1-stage
System Configuration	4	A =	Heat Pump (Cooling default)
		C =	Air Conditioning or Hydronic Heat
Unit Capacity / Heat Exchanger	5-7	020 =	0.50-ton
		030 =	0.75-ton
		040 =	1.00-ton
		050 =	1.25-ton
		060 =	1.50-ton
		080 =	2.00-ton Standard Performance
		081 =	2.00-ton Enhanced Performance
		100 =	2.50-ton
		120 =	3.00-ton
Revision (Major)	8	4 =	4th Generation
Unit Voltage	9	B =	Single Point Power: 208/230-60-1
		D =	Single Point Power: 265-60-1
Compressor	10	C =	Copeland
		B =	Bristol
		T =	Tecumseh
		L =	LG
Distributor Options	11	G =	Geothermal (TXV)
		Y =	Standard (TXV)
Revision (Minor)	12	A =	Original
		B =	1st Revision
		C =	2nd Revision
		D =	3rd Revision
Control Voltage	13	L =	Normally Closed - 24 VAC
		1 =	Normally Open - 24 VAC
Control Type	14	A =	Solid State Control
Sound Attenuation	15	X =	Standard
		A =	Anti-Vibe Compressor Enclosure
Coil / Chassis Protection	16	A =	Standard (Galvanized) Chassis & Galvanized Coil Casing with Copper tube / Aluminum fin
		B =	Standard (Galvanized) Chassis & Galvanized Coil Casing with Tin Dipped Hairpins
		C =	Standard (Galvanized) Chassis & Galvanized Coil Casing with Epoxy Coating (E-Coating)
		F =	Standard (Galvanized) Chassis & Stainless Steel Coil Casing with Copper tube / Aluminum fin
		G =	Standard (Galvanized) Chassis & Stainless Steel Coil Casing with Tin Dipped Hairpins
		H =	Standard (Galvanized) Chassis & Stainless Steel Coil Casing with Epoxy Coating (E-Coating)

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Chassis Nomenclature

Category	Position	Option Digit and Description	
Hot Water Coil	17	X =	None
		B =	2-row Hot Water Coil
		C =	3-row Hot Water Coil
Control Valve	18	X =	None
		A =	2-way valve, on/off, std diff
		B =	2-way valve, on/off, 60 psi diff
		C =	2-way valve, on/off, 125 psi diff
		H =	Pressure Independent Control Valve
		J =	3-way valve, on/off, 30 psi diff (Whisperpack Only)
		K =	3-way valve, on/off, 60 psi diff (Whisperpack Only)
		2 =	Two 2-way valve, on/off, 30 psi diff (Qty 2 valves for use with Whisperpack)
		3 =	Two 2-way valve, on/off, 60 psi diff (Qty 2 valves for use with Whisperpack)
Flow Control	19	4 =	Two 2-way valve, on/off, 125 psi diff (Qty 2 valves for use with Whisperpack)
		X =	None
		C =	Automatic Flow Valve - Griswold K with PT Ports
		D =	Automatic Flow Valve - Hays
		E =	Automatic Flow Valve - Hays with PT Ports
		H =	Manual Flow Control Valve
		L =	Internal Circulating Pump - Taco (208 or 265V)
		M =	Internal Circulating Pump - Grundfos (208V only)
		Q =	Pressure Independent Control Valve
Water Flow	20-23	Z =	Customer specified flow control device - (Special Engineering Request is required)
		0150 =	1.50 GPM
		0200 =	2.00 GPM
		0225 =	2.25 GPM
		0250 =	2.50 GPM
		0300 =	3.00 GPM
		0350 =	3.50 GPM
		0400 =	4.00 GPM
		0450 =	4.50 GPM
		0500 =	5.00 GPM
		0600 =	6.00 GPM
		0700 =	7.00 GPM
		0800 =	8.00 GPM
		0900 =	9.00 GPM
		1000 =	10.00 GPM
Strainer	24	X =	None
		2 =	Y-strainer
		3 =	Y-strainer with blowdown

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Category	Position	Option Digit and Description	
Water Connections	25	A =	GHT (Male)
		C =	NPSH (Straight)
		J =	Insta-Lock Connector
Water-Side Access Ports	26	X =	None
		A =	Pressure / Temperature Port (Supply)
		B =	Pressure / Temperature Port (Return)
		C =	Pressure / Temperature Port (Supply & Return)
		D =	Pressure / Temperature Port (Supply) and Manual Air Vent
		E =	Pressure / Temperature Port (Return) and Manual Air Vent
		F =	Pressure / Temperature Port (Supply & Return) and Manual Air Vent
		G =	Pressure / Temperature Port (Supply) with Manual Air Vent & Drain Petcock
		H =	Pressure / Temperature Port (Return) with Manual Air Vent & Drain Petcock
		J =	Pressure / Temperature Port (Supply & Return) with Manual Air Vent & Drain Petcock
Coax Type	27	A =	Standard
		B =	Cupro-Nickel Coax
		C =	Insulated Coax
		D =	Insulated Cupro-Nickel Coax
Chassis Plug	28	Q =	15 pin Chassis Plug
Air / Fluid Sensor	29	X =	None
		D =	Differential Pressure Switch
Coil Height	30	D =	18" tall
		E =	20" tall
		G =	24" tall
		J =	28" tall
		N =	36" tall

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Table 1A: Whisperpack® Chassis AHRI Performance Ratings – ASHRAE / ANSI / AHRI / ISO Standard 13256-1

Model with EC Motor	AHRI Certified Performance ASHRAE / ANSI / AHRI / ISO Standard 13256-1				Heating GPM	Entering Liquid Temp Heating 105°F	
	CFM	GPM	Water Loop Heat Pump			Capacity Btuh	EER Btuh / W
			Cooling 86°F				
			Capacity Btuh	EER Btuh / W			
VP-C-204*D	290	1.5	6,400	13.70	1.5	7,087	239
VP-C-304*D	345	2.5	9,300	14.00	2.5	8,769	317
VP-C-404*D	465	3.3	11,700	13.80	3.3	9,883	371
VP-C-504*D	540	3.9	14,200	15.70	3.9	14,336	482
VP-C-604*D	650	4.5	17,800	14.60	4.5	16,884	603
VP-C-804*D	865	6.0	22,800	13.00	6.0	22,065	829
VP-C-814*D	830	6.0	22,800	13.50	6.0	21,483	760
VP-C-1004*D	1045	7.5	28,200	13.50	7.5	27,629	944
VP-C-1204*D	1100	9.0	32,600	12.75	9.0	31,791	1124

Cooling based upon 80.6°F DB, 66.2°F WB entering air temperature

Heating based upon 68°F DB, 59°F WB entering air temperature

Performance based upon 208/60/1 voltage

Table 1B: Whispertherm® Thermal Recovery Unit Efficiency Performance (Enthalpy Core)

Winter			Summer	
Outdoor 32°F DB, 29°F WB			Outdoor 95°F DB, 78°F WB	
Indoor 70°F DB, 58°F WB			Indoor 75°F DB, 63°F WB	
CFM	Apparent Sensible Effec- tiveness	Total Recovery Efficiency	Apparent Sensible Effec- tiveness	Total Recovery Efficiency
50	85%	67%	68%	49%

Typical Ventilation System Running Load	
Constant Ventilation Speed	Intermittent Timed High Speed (1)
52 WATTS	98 WATTS

(1) The unit is designed for constant 24/7 ventilation with a timed high-speed washroom exhaust.

The thermal recovery performance shown above applies to the Whalen Whispertherm® product with an integrated TRU.

Features & Benefits of the Energy Recovery Module

Integrated Thermal Recovery Unit The Whispertherm® includes an integrated thermal recovery unit (TRU) having easy access. The TRU is self-contained and includes all items needed for a fully-functioning engineered unit. The unit includes controls to ensure dedicated constant ventilation and high-speed exhaust.



FreshPath™ Technology Industry exclusive system ensures fresh air is pre-treated, filtered (TRU prefilter and then the main unit filter) and conditioned before entering the occupied space.

May Assist in Additional LEED® Points The Whispertherm® unit may allow for additional points based on ventilation and IAQ.

Improves Indoor Air Quality (IAQ) Providing the living space with dedicated tempered ventilation air enhancing personal comfort. The unique unit design allows the Supply Air from the TRU to pass through the main unit filter prior to passing through the unit coil(s).

Multiple Ventilation Rate Settings Factory preset ventilation CFM settings based on the living space size.

“Polar Shield” & Defrost Cycle Included sensors protect freezing air from reaching the unit and/or the space. The outdoor air duct is closed-off and the TRU supply fan is de-energized. The TRU exhaust fan continues to operate, exhausting the warm recovery air from the washroom, until permitted operating conditions are reached.

MERV-6 filters Standard filters are MERV-6 rated.

Occupant (Washroom) Timers The timer allows for activation of timed high speed exhaust, eliminating excess humidity build up and/or odors from the recovery space. The timer is a momentary switch and is adjustable from 5-60 minutes.

Features & Benefits of Whispertherm®

Internal Pump Internal pump is optional on all size units but cannot be used in conjunction with the two-way solenoid valve. The internal pump is an internally mounted ON/OFF circulating pump for use with our single riser applications.

Tin Dipped Coil Optional tin electro-plated copper tubing protect the air coil from many corrosive elements in the air stream. Corrosion often referred to as Formicary Corrosion occurs due to the presence of dissimilar metals such as copper and aluminum in conjunction with water causes results in refrigerant leaks and eventual failure of the air coil costing hundreds of dollars to replace. Studies have also shown that isolating the copper from the aluminum greatly reduces or eliminates the corrosion thereby increasing the life of the air coil.

Constant Torque EC Motor Are standard on all units and provide the efficiency and operability of an ECM at a lower cost than a constant airflow ECM. Constant torque ECMs provide 5 available

motor speed settings and will maintain a constant motor torque as external static pressure in the system increases. As the system static pressure increases, reduction in fan airflow with a constant torque ECM is minor.

Supply Air Grille Diffusers are constructed of aluminum with a mill finish or an optional painted finish, available in three variations: single deflection, double deflection, double deflection with opposed blade damper. Damper blades are positioned vertically and adjust easily for directing the unit discharge air.

Flush Mounted Panel Constructed of heavy gauge steel, lined with insulation to help attenuate sound from the compressor and fan assembly. Magnetic clips ensure the panel doors stay closed during operation. Panel has 2 doors to access the chassis and to access the TRU. Panel is painted appliance white and contains a supply air grille for front supply units.

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Telescoping SA Extension Front supply units come with a sheet metal telescoping supply sleeve standard in the cabinet. A canvas connector can be used for top and side supply ducts. This reduces vibration-induced noise.

Cabinet Stand An optional cabinet stand is available in heights ranging from 2" up to 14" to accommodate interiors with higher baseboard mouldings.

Unfused Disconnect Units are available with an optional non-fused disconnect switch, located on the unit front behind the return air panel. The disconnect switch is used to break power to the unit for safety and ease of service.

Circuit Breaker Units are available with an optional circuit breaker (circuit breaker for secondary overcurrent protection). The circuit breaker is used to break power to the unit for safety and ease of service.

T-stat extension Low voltage wire harness ranging from 5 to 50 foot ending with 6-P-in Molex quick connector. The extension can exit cabinet on the side opposite of the riser location.

Condensate pump The internal condensate pump allows the unit to be located virtually wherever desired. The internal condensate pump serves as an effective means for disposing of condensate generated during heat pump operation. A condensate pump should be designed and installed at the unit to pump condensate to a building drain.

Vibration Isolation Pad Vibration isolator pads dampen vibration from the compressor and fan motors. The 1/2" thick neoprene isolation pads are attached to the bottom of the cabinet at the factory eliminating any additional field labor.

2-Way Valve 2-way valves are used for a variety of pumping applications when more than one unit is installed on a common loop. These valves are also used to shut off flow when the unit is not operating. On a call for cooling or heating the valve opens providing full water flow prior to compressor operation. A 24 volt control wire harness is included with the factory provided control valve option.

Automatic Flow Control An automatic flow control device includes a ball valve cast in the valve body and is located on the return water pipe. The flow control valve consists of a stainless steel/brass flow cartridge and a contoured orifice plate. As the pressure drop increases, the flow cartridge will move into the contoured orifice plate to decrease the flow. This flexing action provides a constant flow, independent of pressure (2-80 psi), makes it difficult to clog and resistant to cavitation damage. This valve sets flow through the coil without any action required by a system balancer.

Manual Flow Control A manual flow control valve, acts as both a flow setting device and a stop valve, taking the place of a ball valve. This valve allows water flow through the unit and can be set quickly and accurately.

Ball Valve Ball valves allow the unit to be shut off for servicing purposes. They have a low resistance to water flow, operate easily. These valves have a compact handle that rotates 90 degrees to a fully open position. The valve body is forged brass and the ball is polished brass with Teflon seats and seals. Ball valves are included on both the supply and return risers.

Memory Stop Adjustable Memory Stop provides both balancing and shutoff in one valve. With the memory stop locked in place, the valve can be closed and then reopened to the same balanced position.

P/T Port An accessible port where pressure and temperature can be measured. Accepts standard 1/8" gauge adapter or thermometer stem.

Strainer The Y-type strainer body is constructed of brass with a 20 gauge 304 stainless steel screen. Used for removal of small particles from the water supply pipe during normal system operation. The strainer helps protect the coil and minimizes the chance of control valves clogging. Screens should be regularly removed and cleaned as part of a routine maintenance schedule.



Stainless Steel Hoses Multiple hose connection types are available.

Insta-lock™ Connection - Braided Hoses Brass body with stainless locking balls and EPDM seals. 304 stainless steel (ASTM A580-18) outer braid. Full flow technology to minimize pressure drop.

GHT Connection - Flexible 302/304 stainless steel hose with EPTF inner tube and FGH connections. Meets UL-94 VO fire rating.

NPSH Connection - 304 Stainless Steel hose with Kevlar® reinforced EPDM core built to ASTM E 84-00 / NFPA 255 standard. EPDM gasket with female NPSH swivel on both ends to provide a reliable seal.

O.A. Internal Duct Three 5" diameter connections are required for TRU.




Filter Units come standard with a one-inch MERV 4 fiberglass throwaway filter. High efficiency MERV 4,

MERV 8, MERV 11, and MERV 13 pleated filters as well as a washable aluminum mesh filter are also available as an option.

Cu-Ni Coaxial Heat Exchanger The optional cupronickel tube-in-tube coaxial heat exchanger used in vertical stack water source heat pumps is designed for maximum heat transfer at normal and low water flow rates with minimum pressure drop. The inside tube is deeply fluted to enhance heat transfer and minimize fouling. All coaxial coils are tested to 400 psig on the water side and 600 psig on the refrigerant side. The extended range chassis has coil and piping insulation to protect against condensation in low-temperature geothermal applications.

Silver Rail Package The silver rail sound package further attenuates the sounds levels of our standard unit by adding a set of rubber in shear isolators under the compressor chassis rails to enhance the dual-level

Table 2: Whispertherm® Thermostats for Standalone Operation

				
Feature		SCI SC2010L	SCI SC4011	SCI SC5011
Mounting Style	Electrical Box			
	Drywall	•	•	•
Display	Backlit LCD	•	•	•
	Temperature & Setpoint	•	•	•
	Operating Mode	•	•	•
	Fan Status	•	•	•
	Remote Setback	•	•	•
Operation	Non-programmable	•	•	
	Programmable			7 day
	Sensing	Local or Remote	Local or Remote	Local or Remote
	Setpoint Range	45°F to 90°F	45°F to 90°F	45°F to 90°F
	Changeover	Manual	Automatic	Manual or Automatic
Operating Modes	System Settings	Heat - Cool - Auto - Off	Heat - Cool - Auto - Off	Heat - Cool - Auto - Off
	Fan Settings	On - Auto	On - Auto	On - Auto
	Fan Speeds	1	1	1
Stages	Heating	1	1	1
	Cooling	1	1	1
Voltage	Operating Voltage	20 - 30 VAC	20 - 30 VAC	20 - 30 VAC

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Unit Protections & LED Fault Status Annunciation

Refrigerant Circuit High Pressure Protection

A normally closed high (compressor discharge) pressure switch is used to help protect the refrigerant circuit from excessively high pressure. If the high pressure switch opens twice within 1 hour, the control board will initiate a hard lockout and the alarm contact will energize.

Refrigerant Circuit Low Pressure Protection

A normally closed low (compressor suction) refrigerant pressure switch is used to help protect the refrigerant circuit from excessively low refrigerant pressure. If the low pressure switch opens twice within 1 hour, the control board will initiate a hard lockout and the alarm contact will energize.

Condensate Overflow Sensor


The control is designed to sense when condensate water levels in the drain pan become excessively high. When high condensate water levels are detected, the controller will go into condensate overflow warning mode. If the condensate overflow sensor detects liquid twice within 1 hour, the control board will initiate a hard lockout and the alarm contact will energize.

Heat Exchanger Low Temperature Protection

The control is designed to sense when the refrigerant temperature drops to a temperature where it is possible to freeze the air coil or the coaxial heat exchanger. The threshold temperature is field selectable for 10°, 20°, or 32°F. If the Freeze Sensor drops below the set temperature twice within 1 hour, the control board will initiate a hard lockout and the alarm contact will energize.

Low water temperature

The control is designed to sense when the leaving water temperature drops to a temperature where it is possible to freeze the coaxial heat exchanger or raises to a temperature high enough to cause possible damage to the compressor. The threshold

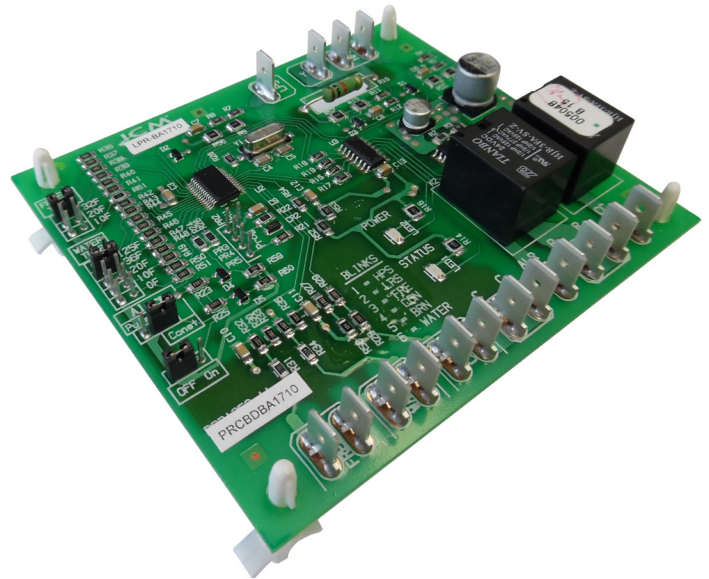

temperature is field selectable for 0°, 10°, 20°, 36°, or 125°F. If the sensor drops below (or above 125°) the set temperature twice within 1 hour, the control board will initiate a hard lockout and the alarm contact will energize.

Low Voltage (Brownout) Protection


The solid state control will monitor the 24 volt power input supplied to the board. If the supply voltage drops below 18 VAC, the control module will shut down the unit to protect electrical components from low line voltage conditions.

Soft Lockout Reset

This feature is used to minimize nuisance trips of safeties caused by temporary conditions that might inhibit the unit from performing normal functions. When a safety trip occurs, it is counted and the alarm is cleared when the condition returns to normal. If the alarm occurs two times within a 1-hour period, the heat pump remains off (locked out) until the unit is checked and the alarm is manually cleared.

Multi-Protocol DDC Controller

The Whalen Company water source heat pumps are available with a factory installed multi-protocol communication module that is designed to communicate with a building automation system (BAS). The I/O Zone 560 DDC controller is designed to allow the integration of Whalen water source heat pump equipment into DDC systems. The I/O Zone 560 DDC controller has the ability to communicate through a choice of three widely used protocols: BACnet MS/

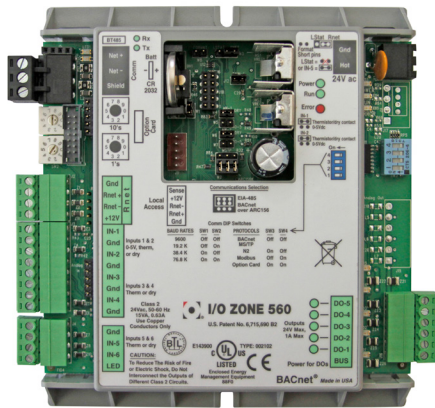

TP, Johnson Controls N2, and Modbus. The protocol of choice for the particular system is selected by simply configuring DIP switches on the DDC control. This flexibility allows one controller to be used in a multitude of buildings which use any of these three common protocols. The control serves as a node of information processing between the Whalen heat pump and the DDC network.

TP, Johnson Controls N2, and Modbus. The protocol of choice for the particular system is selected by simply configuring DIP switches on the DDC control. This flexibility allows one controller to be used in a multitude of buildings which use any of these three common protocols. The control serves as a node of information processing between the Whalen heat pump and the DDC network.

Features & Benefits

- Multi-Protocol communications provides DDC system flexibility.
- Supports native BACnet MS/TP communications – the ASHRAE standard protocol for interoperability.
- Supports Johnson Controls N2 communications – for integration into Johnson Controls Metasys DDC systems.
- Supports Modbus communications for integration into Modbus DDC networks.
- Four baud rate levels offer flexible communications speeds of 9600, 19.2k, 38.4k, or 76.8k baud. Enables building operators to easily upgrade firmware in the future.
- Removable field wiring connectors for ease of field service.
- Five (5) digital outputs.
- Six (6) inputs.
- Stand-alone or BAS integrated operational modes.

Hardware Specification

Power:	24Vac \pm 10%, 50 or 60Hz, 18VA power consumption, 26Vdc, Single Class 2 source only, 100 VA or less.
Physical size:	5-1/16" [129mm] width x 5-11/16" [144mm] height x 1-1/2" [38mm] (minimum panel depth).
Housing material:	Rugged GE C2905HG Cylcoloy plastic housing – complies with UL 94 V-O.
Environmental:	0 to 130 degrees F, 10% to 95% non-condensing.
Protection:	Built-in surge transient protection circuitry. Module protected by Internal solid state Polyswitches on incoming power and network connections.
Digital Outputs:	5 digital outputs, relay contacts rated at 1 A resistive @ 24 Vac, configured as dry contact, normally open.
Universal inputs:	6 universal inputs. Inputs 1-6 configurable as thermistor or dry contact; inputs 1 and 2 also configurable as 0-5 Vdc type inputs.
Communication ports:	Port 1: Jumper configurable for ARCNET or EIA-485 communication. In ARCNET mode, the port speaks BACnet (at 156k bps). In EIA-485 mode, the communication protocol and baud rate desired are DIP switch selectable between BACnet MS/TP, Modbus RTU, or N2. Rnet port: Interface with a BACview5, BACview6, RS sensors, or local laptop.
Optional card port:	LonWorks Option Card for connection to Free Topology LON networks (TP/FT-10 Channel).

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Table 3: Physical Data Table

Component	Models								
	V(T,N)-C-0204	V(T,N)-C-0304	V(T,N)-C-0404	V(T,N)-C-0504	V(T,N)-C-0604	V(T,N)-C-0804	V(T,N)-C-0814	V(T,N)-C-1004	V(T,N)-C-1204
Nominal Tonnage	0.5	0.75	1.0	1.25	1.5	2.0	2.0	2.5	3.0
COOLING PERFORMANCE									
Capacity (MBTUH)	6.4	9.3	11.7	14.2	17.8	22.8	22.8	28.2	32.6
EER (Btuh/W)	13.7	14.0	13.8	15.7	14.6	13.0	13.5	13.5	12.8
Entering Water Temp (°F)	86	86	86	86	86	86	86	86	86
Water Flow (GPM)	1.5	2.5	3.3	3.9	4.5	6.0	6.0	7.5	9.0
Rated CFM	290	345	465	540	650	865	830	1045	1100
Refrigerant type	R410A	R410A	R410A	R410A	R410A	R410A	R410A	R410A	R410A
Refrigerant charge (oz)	23.0	24.0	26.3	33.0	34.0	36.0	43.0	46.0	51.0
HEATING PERFORMANCE									
Capacity (MBTUH)	7.1	8.8	9.9	14.3	16.9	22.1	21.5	27.6	31.8
EER (Btuh/W)	270	300	360	475	600	800	760	950	1100
Entering Water Temp (°F)	105	105	105	105	105	105	105	105	105
Water Flow (GPM)	1.5	2.5	3.3	3.9	4.5	6.0	6.0	7.5	9.0
DIMENSIONS (inches)									
Width (in.)	21	21	21	21	21	21	21	21	21
Depth (in.)	28	28	28	28	28	28	29	29	29
Height (in.)	84	84	84	84	84	84	93	93	93
OPERATING WEIGHT (lbs.)									
Chassis	82	84	87	129	130	142	177	177	188
Cabinet	260	260	260	260	260	260	290	290	290
SHIPPING WEIGHT (lbs.)									
Chassis	88	90	93	135	136	148	183	183	194
Cabinet	272	272	272	272	272	272	302	302	302
COMPRESSORS									
Type	Recip	Recip	Recip	Recip	Recip	Scroll	Scroll	Scroll	Scroll
Quantity	1	1	1	1	1	1	1	1	1
EVAPORATOR COIL DATA									
Cooling Coil (rows)	3 or 4	3 or 4	3 or 4	3 or 4	3 or 4	3 or 4	3 or 4	3 or 4	3 or 4
Heating Coil (rows)	2 or 3	2 or 3	2 or 3	2 or 3	2 or 3	2 or 3	2 or 3	2 or 3	2 or 3
Refrigerant control	TXV	TXV	TXV	TXV	TXV	TXV	TXV	TXV	TXV
SUPPLY FAN DATA									
Quantity	1	1	1	1	1	1	1	1	1
Fan Size (D x W)	7.62 x 5	7.62 x 5	8.5 x 7	8.5 x 7	8.5 x 7	9 x 8	9.5 x 9.5	10 x 6	10 x 6
Fan type	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
Maximum E.S.P.									
ECM Motor - Constant Torque	0.35	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5
ECM Motor - Constant Volume	0.35	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5
CONSTANT TORQUE ECM HP									
Voltage - 208-230/60/1	1/4	1/4	1/4	1/4	1/4	1/2	1/2	1/2	1/2
Voltage - 265/60/1	1/4	1/4	1/4	1/4	1/4	1/2	1/2	1/2	1/2
CONSTANT VOLUME ECM HP									
Voltage - 208-230/60/1	1/3	1/3	1/3	1/3	1/3	1/2	1/2	1/2	1/2
Voltage - 265/60/1	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
ACOUSTICAL RETURN AIR PANEL									
Standard	15.5 x 37.8	15.5 x 37.8	15.5 x 37.8	17.5 x 39.8	17.5 x 39.8	17.5 x 39.8	19.5 x 53.8	19.5 x 53.8	19.5 x 53.8
Flush Mounted	21 x 39	21 x 39	21 x 39	24 x 41	24 x 41	24 x 41	27 x 55	27 x 55	27 x 55
Chassis Accessable Flush Mounted	22 x 39.8	22 x 39.8	22 x 39.8	25 x 41.8	25 x 41.8	25 x 41.8	28 x 55.8	28 x 55.8	28 x 55.8
SUPPLY GRILLE									
1 Grille (W x H)	10 x 8	14 x 8	14 x 10	16 x 12	16 x 12	16 x 16	16 x 16	NA	NA
2 Grille (W x H)	10 x 4	14 x 6	14 x 6	16 x 6	16 x 6	16 x 6	16 x 8 & 8 x 18	16 x 14 & 10 x 18	16 x 16 & 10 x 20
2 Grille Cornerstone (W x H)	4 x 10	6 x 14	6 x 14	8 x 16	8 x 16	8 x 16	8 x 18	10 x 18	10 x 20
3 Grille (W x H)	10 x 4	14 x 6	14 x 6	16 x 6	16 x 6	16 x 6	16 x 8 & 8 x 18	16 x 14 & 10 x 18	16 x 16 & 10 x 20
Top Duct (W x H)	12 x 10	12 x 10	12 x 12	14 x 14	14 x 14	14 x 16	14 x 16	14 x 16	14 x 16
FILTERS									
Size	13 x 24 1	13 x 24 1	13 x 24 x 1	15 x 28 x 1	15 x 28 x 1	15 x 28 x 1	17 x 40 x 1	17 x 40 x 1	17 x 40 x 1
Quantity	1	1	1	1	1	1	1	1	1

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Table 4: VT / VR Unit Voltage Limitations

Voltage	Minimum	Maximum
208/230-60-1	197	252
265-60-1	239	292

Table 5: Whisperpack® Chassis Continuous Operating Limits

Continuous Mode	Ambient Air °F		Entering Air °F				Entering Fluid °F			
	Min	Max	Min		Max		Standard Range		Extended Range	
	DB	DB	DB	WB	DB	WB	Min	Max	Min	Max
Cooling	60	100	75	63	100	83	60	120	30	120
Heating	60	80	60	–	80	–	60	140	60	140

Note: Extended Range **requires** insulated risers, correct control jumper setting, and design condition antifreeze solution

Table 6: Whisperpack® Chassis Start-up Operating Limits

Start-up Mode	Ambient Air °F		Entering Air °F				Entering Fluid °F			
	Min	Max	Min		Max		Standard Range		Extended Range	
	DB	DB	DB	WB	DB	WB	Min	Max	Min	Max
Cooling	50	100	50	42	100	83	50	120	30	120
Heating	50	80	50	–	80	–	50	90	20	90

Note: Extended Range **requires** insulated risers, correct control jumper setting, and design condition antifreeze solution

Standard Range Units:

Units are designed to start in an ambient of 50°F (10°C) with entering air at 50°F (10°C), with entering water at 50°F (10°C), with nominal air flow and water flow (3.0 GPM/Ton), for initial start-up in heating and cooling mode.

Note: This is not a normal or continuous operating condition. It is assumed that such start-up is for the purpose of bringing the building space up to occupancy temperature and operating for extended periods of time.

Extended Range Units:

Units are designed to start in an ambient of 50°F (10°C) with entering air at 50°F (10°C), with entering water at 20°F (-7°C), with nominal air flow and water flow (3.0 GPM/Ton), for initial start-up in heating.

Units are designed to start in an ambient of 50°F (10°C) with entering air at 50°F (10°C), with entering

Table 7: Whisperpack® Outdoor Temperature Reset

Outdoor Air Temperature	Water Temperature
Below 0°	120° Max
0°	115°
10°	110°
20°	105°
30°	100°
40°	90°
Above 41°	85° Min

water at 30°F (-1°C), with nominal air flow and water flow (3.0 GPM/Ton), for initial start-up in cooling.

Note: This is not a normal or continuous operating condition. It is assumed that such start-up is for the purpose of bringing the building space up to occupancy temperature and operating for extended periods of time.

Environment

This equipment is designed for indoor installation only. Unconditioned locations such as attics, garages, etc., generally will not provide sufficient protection against extremes in temperature and/or humidity, and equipment performance, reliability, and service life may be adversely affected.

Power supply

A voltage variation of +/-10% of nameplate voltage is acceptable.



Cooling Performance - 2-row Coil

Size (Tons)	EWT (°F)	GPM	Entering Air - 80°F / 67°F					Entering Air - 78°F / 65°F					Entering Air - 75°F / 63°F				
			TC (Btu/hr)	SC (Btu/hr)	kW	HR (Btu/hr)	Liquid Temp Rise (°F)	TC (Btu/hr)	SC (Btu/hr)	kW	HR (Btu/hr)	Liquid Temp Rise (°F)	TC (Btu/hr)	SC (Btu/hr)	kW	HR (Btu/hr)	Liquid Temp Rise (°F)
0204 (0.5)	90	1.0	5.80	5.19	0.54	7.64	15.3	5.55	5.19	0.54	7.39	14.8	5.30	4.91	0.54	7.14	14.3
		1.25	5.96	5.26	0.52	7.74	12.4	5.71	5.26	0.52	7.49	12.0	5.45	4.97	0.52	7.23	11.6
		1.5	6.01	5.29	0.51	7.76	10.3	5.76	5.29	0.51	7.50	10.0	5.50	5.00	0.51	7.24	9.7
0304 (0.75)	90	1.5	9.18	7.22	0.75	11.72	15.6	8.79	7.23	0.74	11.33	15.1	8.39	6.83	0.74	10.93	14.6
		1.875	9.28	7.27	0.73	11.75	12.5	8.88	7.28	0.72	11.35	12.1	8.49	6.88	0.72	10.95	11.7
		2.5	9.42	7.30	0.71	11.82	9.5	9.02	7.31	0.70	11.42	9.1	8.61	6.91	0.70	11.02	8.8
0404 (1.0)	90	2	12.49	9.56	0.97	15.80	15.8	11.96	9.57	0.97	15.26	15.3	11.43	9.04	0.97	14.72	14.7
		2.5	12.61	9.62	0.94	15.83	12.7	12.07	9.63	0.94	15.29	12.2	11.53	9.10	0.94	14.75	11.8
		3.3	12.76	9.66	0.92	15.90	9.6	12.22	9.67	0.92	15.35	9.3	11.67	9.14	0.92	14.81	9.0
0504 (1.25)	90	2.5	14.92	11.54	1.11	18.71	15.0	14.28	11.56	1.11	18.07	14.5	13.65	10.92	1.11	17.43	13.9
		3.125	15.11	11.66	1.07	18.75	12.0	14.47	11.67	1.07	18.10	11.6	13.83	11.03	1.06	17.46	11.2
		3.9	15.13	11.62	1.04	18.68	9.6	14.49	11.64	1.04	18.03	9.2	13.84	11.00	1.04	17.38	8.9
0604 (1.5)	90	3	17.87	13.51	1.35	22.47	15.0	17.11	13.53	1.35	21.71	14.5	16.35	12.78	1.35	20.94	14.0
		3.75	18.12	13.50	1.30	22.57	12.0	17.35	13.52	1.30	21.80	11.6	16.58	12.78	1.30	21.02	11.2
		4.5	18.22	13.60	1.28	22.57	10.0	17.44	13.62	1.27	21.79	9.7	16.67	12.87	1.27	21.01	9.3
0804 (2.0)	90	4	21.58	17.56	1.89	28.03	14.0	20.66	17.58	1.89	27.10	13.6	19.74	16.61	1.88	26.17	13.1
		5	22.03	17.79	1.84	28.29	11.3	21.09	17.81	1.83	27.34	10.9	20.15	16.83	1.83	26.40	10.6
		6	22.27	17.92	1.81	28.43	9.5	21.32	17.95	1.80	27.47	9.2	20.37	16.96	1.80	26.52	8.8
0814 (2.0)	90	4	24.02	18.70	1.80	30.18	15.1	23.00	18.72	1.80	29.15	14.6	21.98	17.69	1.80	28.12	14.1
		5	24.56	18.83	1.76	30.55	12.2	23.51	18.85	1.76	29.50	11.8	22.46	17.81	1.75	28.45	11.4
		6	24.80	18.91	1.74	30.73	10.2	23.75	18.93	1.74	29.67	9.9	22.69	17.89	1.73	28.60	9.5
1004 (2.5)	90	5	27.98	20.75	2.13	35.25	14.1	26.79	20.78	2.13	34.05	13.6	25.60	19.63	2.12	32.85	13.1
		6.25	28.33	20.92	2.08	35.41	11.3	27.12	20.94	2.07	34.20	10.9	25.92	19.79	2.07	32.98	10.6
		7.5	28.51	20.99	2.04	35.48	9.5	27.29	21.02	2.04	34.25	9.1	26.08	19.86	2.04	33.03	8.8
1204 (3.0)	90	6	30.96	24.75	2.68	40.11	13.4	29.64	24.78	2.68	38.78	12.9	28.32	23.41	2.68	37.45	12.5
		7.5	31.58	25.08	2.60	40.46	10.8	30.23	25.12	2.60	39.10	10.4	28.89	23.73	2.60	37.74	10.1
		9	31.92	25.28	2.56	40.65	9.0	30.56	25.31	2.55	39.28	8.7	29.20	23.92	2.55	37.91	8.4

Heating Performance - 2-row Coil

Size (Tons)	EWT (°F)	GPM	Entering Air - 65°F db			Entering Air - 70°F db			Entering Air - 75°F db		
			HC (Btu/hr)	Supply Temp (°F)	Liquid Temp Drop (°F)	HC (Btu/hr)	Supply Temp (°F)	Liquid Temp Drop (°F)	HC (Btu/hr)	Supply Temp (°F)	Liquid Temp Drop (°F)
0204 (0.5)	120	1.0	10.30	98	20.8	9.02	99	18.2	7.73	100	15.7
		1.25	10.97	101	17.7	9.60	101	15.5	8.23	102	13.3
		1.5	11.44	102	15.4	10.02	103	13.5	8.58	103	11.6
0304 (0.75)	120	1.5	12.70	101	17.1	11.11	101	15.0	9.52	102	12.8
		1.875	13.42	103	14.4	11.74	103	12.7	10.06	103	10.9
		2.5	14.16	105	11.4	12.39	105	10.0	10.61	105	8.6
0404 (1.0)	120	2	15.08	102	15.4	13.19	102	13.5	11.32	103	11.6
		2.5	15.84	104	12.9	13.85	104	11.3	11.88	104	9.8
		3.3	16.17	105	10.0	14.14	105	8.8	12.14	105	7.6
0504 (1.25)	120	2.5	21.00	105	17.0	18.46	105	15.0	15.89	105	12.9
		3.125	22.02	107	14.2	19.35	107	12.5	16.66	107	10.8
		3.9	22.88	109	11.9	20.11	108	10.4	17.32	108	9.0
0604 (1.5)	120	3	25.04	103	17.0	22.02	104	15.0	18.91	104	12.9
		3.75	26.16	105	14.2	23.01	105	12.5	19.76	105	10.8
		4.5	26.96	106	12.2	23.71	106	10.7	20.36	106	9.2
0804 (2.0)	120	4	32.92	101	16.8	28.87	101	14.8	24.79	102	12.7
		5	34.28	102	14.0	30.07	103	12.3	25.82	103	10.6
		6	35.39	103	12.0	31.05	104	10.6	26.66	104	9.1
0814 (2.0)	120	4	32.05	101	16.3	28.11	102	14.4	24.14	102	12.4
		5	33.38	103	13.6	29.28	103	12.0	25.14	104	10.3
		6	34.46	104	11.7	30.23	104	10.3	25.96	105	8.9
1004 (2.5)	120	5	41.29	106	16.8	36.21	106	14.8	31.10	106	12.7
		6.25	43.05	107	14.0	37.75	107	12.3	32.42	107	10.6
		7.5	44.27	109	12.0	38.82	108	10.5	33.34	108	9.1
1204 (3.0)	120	6	47.59	104	16.2	41.79	104	14.2	35.88	104	12.3
		7.5	49.51	105	13.5	43.48	105	11.8	37.32	105	10.2
		9	50.85	106	11.5	44.66	106	10.1	38.33	106	8.7

Capacity Table Legend:

Btu/hr = British Thermal Units per Hour
 CFM = Airflow Rate, Cubic Feet per Minute
 EWT = Entering Water Temperature
 GPM = Gallons per Minute
 HC = Heating Capacity
 HE = Heat of Extraction
 HR = Heat of Rejection
 kW = Kilowatts
 SC = Sensible Capacity
 TC = Total Capacity

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Whispertherm® with Whisperpack® Chassis 3-Row Performance Data

Cooling Performance - 3-row Coil

Size (Tons)	EWT (°F)	GPM	Entering Air - 80°F / 67°F					Entering Air - 78°F / 65°F					Entering Air - 75°F / 63°F				
			TC (Btu/hr)	SC (Btu/hr)	kW	HR (Btu/hr)	Liquid Temp Rise (°F)	TC (Btu/hr)	SC (Btu/hr)	kW	HR (Btu/hr)	Liquid Temp Rise (°F)	TC (Btu/hr)	SC (Btu/hr)	kW	HR (Btu/hr)	Liquid Temp Rise (°F)
0204 (0.5)	90	1	5.80	5.19	0.54	7.64	15.3	5.55	5.19	0.54	7.39	14.8	5.30	4.91	0.54	7.14	14.3
		1.25	5.96	5.26	0.52	7.74	12.4	5.71	5.26	0.52	7.49	12.0	5.45	4.97	0.52	7.23	11.6
		1.5	6.01	5.29	0.51	7.76	10.3	5.76	5.29	0.51	7.50	10.0	5.50	5.00	0.51	7.24	9.7
0304 (0.75)	90	1.5	9.18	7.22	0.75	11.72	15.6	8.79	7.23	0.74	11.33	15.1	8.39	6.83	0.74	10.93	14.6
		1.875	9.28	7.27	0.73	11.75	12.5	8.88	7.28	0.72	11.35	12.1	8.49	6.88	0.72	10.95	11.7
		2.5	9.42	7.30	0.71	11.82	9.5	9.02	7.31	0.70	11.42	9.1	8.61	6.91	0.70	11.02	8.8
0404 (1.0)	90	2	12.49	9.56	0.97	15.80	15.8	11.96	9.57	0.97	15.26	15.3	11.43	9.04	0.97	14.72	14.7
		2.5	12.61	9.62	0.94	15.83	12.7	12.07	9.63	0.94	15.29	12.2	11.53	9.10	0.94	14.75	11.8
		3.3	12.76	9.66	0.92		9.6	12.22	9.67	0.92	15.35	9.3	11.67	9.14	0.92	14.81	9.0
0504 (1.25)	90	2.5	14.92	11.54	1.11	18.71	15.0	14.28	11.56	1.11	18.07	14.5	13.65	10.92	1.11	17.43	13.9
		3.125	15.11	11.66	1.07	18.75	12.0	14.47	11.67	1.07	18.10	11.6	13.83	11.03	1.06	17.46	11.2
		3.9	15.13	11.62	1.04	18.68	9.6	14.49	11.64	1.04	18.03	9.2	13.84	11.00	1.04	17.38	8.9
0604 (1.5)	90	3	17.87	13.51	1.35	22.47	15.0	17.11	13.53	1.35	21.71	14.5	16.35	12.78	1.35	20.94	14.0
		3.75	18.12	13.50	1.30	22.57	12.0	17.35	13.52	1.30	21.80	11.6	16.58	12.78	1.30	21.02	11.2
		4.5	18.22	13.60	1.28	22.57	10.0	17.44	13.62	1.27	21.79	9.7	16.67	12.87	1.27	21.01	9.3
0804 (2.0)	90	4	21.58	17.56	1.89	28.03	14.0	20.66	17.58	1.89	27.10	13.6	19.74	16.61	1.88	26.17	13.1
		5	22.03	17.79	1.84	28.29	11.3	21.09	17.81	1.83	27.34	10.9	20.15	16.83	1.83	26.40	10.6
		6	22.27	17.92	1.81	28.43	9.5	21.32	17.95	1.80	27.47	9.2	20.37	16.96	1.80	26.52	8.8
0814 (2.0)	90	4	24.02	18.70	1.80	30.18	15.1	23.00	18.72	1.80	29.15	14.6	21.98	17.69	1.80	28.12	14.1
		5	24.56	18.83	1.76	30.55	12.2	23.51	18.85	1.76	29.50	11.8	22.46	17.81	1.75	28.45	11.4
		6	24.80	18.91	1.74	30.73	10.2	23.75	18.93	1.74	29.67	9.9	22.69	17.89	1.73	28.60	9.5
1004 (2.5)	90	5	27.98	20.75	2.13	35.25	14.1	26.79	20.78	2.13	34.05	13.6	25.60	19.63	2.12	32.85	13.1
		6.25	28.33	20.92	2.08	35.41	11.3	27.12	20.94	2.07	34.20	10.9	25.92	19.79	2.07	32.98	10.6
		7.5	28.51	20.99	2.04	35.48	9.5	27.29	21.02	2.04	34.25	9.1	26.08	19.86	2.04	33.03	8.8
1204 (3.0)	90	6	30.96	24.75	2.68	40.11	13.4	29.64	24.78	2.68	38.78	12.9	28.32	23.41	2.68	37.45	12.5
		7.5	31.58	25.08	2.60	40.46	10.8	30.23	25.12	2.60	39.10	10.4	28.89	23.73	2.60	37.74	10.1
		9	31.92	25.28	2.56	40.65	9.0	30.56	25.31	2.55	39.28	8.7	29.20	23.92	2.55	37.91	8.4

Heating Performance - 3-row Coil

Size (Tons)	EWT (°F)	GPM	Entering Air - 65°F db			Entering Air - 70°F db			Entering Air - 75°F db		
			HC (Btu/hr)	Supply Temp (°F)	Liquid Temp Drop (°F)	HC (Btu/hr)	Supply Temp (°F)	Liquid Temp Drop (°F)	HC (Btu/hr)	Supply Temp (°F)	Liquid Temp Drop (°F)
0204 (0.5)	120	1	12.20	105	24.6	10.67	105	21.6	9.14	105	18.5
		1.25	12.96	107	20.9	11.34	107	18.3	9.71	107	15.7
		1.5	13.48	109	18.1	11.80	108	15.9	10.10	108	13.6
0304 (0.75)	120	1.5	14.55	106	19.6	12.75	106	17.2	10.93	106	14.7
		1.875	15.23	108	16.4	13.35	107	14.4	11.44	107	12.3
		2.5	15.82	109	12.7	13.86	109	11.2	11.88	108	9.6
0404 (1.0)	120	2	16.63	106	17.0	14.58	106	14.9	12.50	106	12.8
		2.5	17.41	108	14.2	15.26	107	12.5	13.09	107	10.7
		3.3	18.15	109	11.2	15.90	109	9.8	13.64	108	8.5
0504 (1.25)	120	2.5	25.13	113	20.3	22.03	112	17.8	18.89	111	15.3
		3.125	26.18	115	16.9	22.95	114	14.8	19.68	113	12.7
		3.9	26.91	116	13.9	23.58	115	12.2	20.22	114	10.5
0604 (1.5)	120	3	29.70	110	20.1	26.08	110	17.7	22.44	109	15.2
		3.75	30.97	112	16.7	27.20	111	14.7	23.40	111	12.7
		4.5	31.78	113	14.3	27.91	112	12.6	24.01	112	10.9
0804 (2.0)	120	4	39.71	108	20.2	34.80	108	17.7	29.85	107	15.2
		5	41.52	110	16.9	36.39	110	14.8	31.20	109	12.7
		6	42.72	111	14.4	37.44	111	12.7	32.10	110	10.9
0814 (2.0)	120	4	38.52	109	19.6	33.76	108	17.2	28.95	108	14.8
		5	40.27	111	16.4	35.29	110	14.4	30.27	109	12.4
		6	41.43	112	14.0	36.31	111	12.3	31.14	110	10.6
1004 (2.5)	120	5	47.83	112	19.4	41.95	111	17.1	36.01	110	14.7
		6.25	49.66	114	16.1	43.55	113	14.2	37.39	112	12.2
		7.5	50.80	115	13.7	44.54	114	12.1	38.24	113	10.4
1204 (3.0)	120	6	54.69	110	18.5	47.95	109	16.3	41.16	108	14.0
		7.5	56.85	111	15.4	49.84	111	13.5	42.78	110	11.7
		9	58.26	112	13.2	51.07	112	11.6	43.84	111	9.9

Capacity Table Legend:

Btu/hr = British Thermal Units per Hour
 CFM = Airflow Rate, Cubic Feet per Minute
 EWT = Entering Water Temperature
 GPM = Gallons per Minute
 HC = Heating Capacity
 HE = Heat of Extraction
 HR = Heat of Rejection
 kW = Kilowatts
 SC = Sensible Capacity
 TC = Total Capacity

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



For each of the five nominal fan sizes, the outdoor air CFM at the Tempered Outdoor conditions is mixed with the indoor supply air to the cooling / heating air coil.

25 CFM Nominal

Cooling					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
95	79	75	63	77.4	67.5
95	79	78	65	80.0	68.9
95	79	80	67	81.8	70.3

35 CFM Nominal

Cooling					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
95	79	75	63	78.0	67.9
95	79	78	65	80.6	69.3
95	79	80	67	82.3	70.6

50 CFM Nominal

Cooling					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
95	79	75	63	78.6	68.4
95	79	78	65	81.1	69.7
95	79	80	67	82.7	71.0

70 CFM Nominal

Cooling					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
95	79	75	63	79.6	69.5
95	79	78	65	81.9	70.7
95	79	80	67	83.5	71.8

90 CFM Nominal

Cooling					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
95	79	75	63	80.4	70.1
95	79	78	65	82.6	71.1
95	79	80	67	84.1	72.2

Heating					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
32	29.0	71.6	57	66.8	51.9
-13	-14.0	71.6	57	61.4	49.0
-31	-31.5	71.6	57	59.3	47.9

Heating					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
32	29.0	71.6	57	65.7	51.2
-13	-14.0	71.6	57	58.9	47.6
-31	-31.5	71.6	57	56.2	46.2

Heating					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
32	29.0	71.6	57	64.5	50.4
-13	-14.0	71.6	57	56.4	46.0
-31	-31.5	71.6	57	53.1	44.3

Heating					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
32	29.0	71.6	57	62.5	48.7
-13	-14.0	71.6	57	52.1	42.9
-31	-31.5	71.6	57	48.0	40.7

Heating					
Outdoor °F		Indoor °F		Tempered Outdoor °F	
Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb	Dry Bulb	Wet Bulb
32	29.0	71.6	57	60.9	47.7
-13	-14.0	71.6	57	48.8	40.8
-31	-31.5	71.6	57	43.9	38.0

Table 8: VP Blower EC Constant Torque Performance Table²

Unit	System Mode	Rated CFM	Min. CFM	Fan Option		CFM at External Static Pressure (in wg.)										
				Option	Speed	0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50
0204-xG (0.5)	Cool	290	170	EC Constant Torque	HI ¹	310	294	271	240	202						
					LOW											
	Heat	260	N/A		HI ¹	283	262	235	203	166						
					LOW											
0304-xG (0.75)	Cool	345	220	EC Constant Torque	HI ¹	369	344	315	283	248						
					LOW	258	228									
	Heat	290	N/A		HI ¹	329	289	250	211	171						
					LOW	224	194									
0404-xG (1.0)	Cool	465	280	EC Constant Torque	HI ¹	494	470	446	422	399	377	354	333			
					LOW	398	365	333	300							
	Heat	345	N/A		HI ¹	377	344	312	279	246						
					LOW	341	286	232								
0504-xG (1.25)	Cool	540	380	EC Constant Torque	HI ¹	559	541	523	504	485	464	443	420	397		
					LOW	427	401	380								
	Heat	460	N/A		HI ¹	482	464	441	412	378	339	295				
					LOW	379	353	315								
0604-xG (1.5)	Cool	650	420	EC Constant Torque	HI ¹	662	649	636	621	606	590	573	556	537	518	498
					LOW	538	519	496	470	441						
	Heat	590	N/A		HI ¹	604	591	577	562	546	530	512	494	474	454	433
					LOW	482	464	441								
0804-xD (2.0)	Cool	865	580	EC Constant Torque	HI ¹	902	886	870	853	837	821	804	788	771	755	738
					LOW	752	731	710	690	671	652	633	615	598		
	Heat	790	N/A		HI ¹	848	829	810	792	773	755					
					LOW	645	625	605	585							
0814-xD (2.0)	Cool	865	580	EC Constant Torque	HI ¹	881	865	849	833	819	804	790	777	764	752	740
					LOW	728	709	692	675	660	645	631	619	607	596	586
	Heat	790	N/A		HI ¹	809	792	775	759	744	730	716	704	692	681	671
					LOW	670	650	632	614	598	584					
1004-xD (2.5)	Cool	1045	650	EC Constant Torque	HI ¹	1018	1001	983	966	949	933	916	900	884	869	853
					LOW	845	828	811	793	776	758	741	723	705	686	668
	Heat	935	N/A		HI ¹	936	918	900	882	864	847	829	812	795		
					LOW	730	713	695	676	657						
1204-xD (3.0)	Cool	1100	750	EC Constant Torque	HI ¹	1244	1227	1211	1194	1178	1161	1145	1129	1113	1097	1081
					LOW	1029	1012	994	977	960	944	927	911	895	880	864
	Heat	1080	N/A		HI ¹	1131	1113	1095	1077	1059	1041	1024	1006	988		
					LOW	858	841	824	807	789						

¹ - Indicates single / high speed factory default setting

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Table 10: VT / VR Airflow Correction Factors

	Percent of Nominal Airflow								
	70	75	80	85	90	95	100	105	110
Total Cooling Capacity	0.94	0.96	0.99	0.99	0.99	0.10	1.00	1.01	1.01
Sensible Cooling Capacity	0.76	0.80	0.84	0.88	0.92	0.96	1.00	1.03	1.07
kW - Cooling	0.99	0.10	0.10	0.10	0.10	0.10	1.00	1.00	1.00
Heat of Rejection	0.94	0.97	0.99	0.99	0.99	0.10	1.00	1.01	1.01
Total Heating Capacity	0.97	0.97	0.98	0.99	0.99	0.10	1.00	1.01	1.01
kW - Heating	1.07	1.05	1.04	1.02	1.01	1.01	1.00	0.99	0.99
Heat of Extraction	0.96	0.97	0.98	0.98	0.99	0.99	1.00	1.01	1.01

Table 11: VT / VR Entering Air Correction Factors - Cooling

Ent. Air WB (°F)	Total Capacity	Sensible Capacity-Entering Air Dry Bulb, °F							Power	Heat of Rejection
		70	75	80	80.6	85	90	95		
60.0	0.96	0.85	0.98	1.10	1.12	*	*	*	0.99	0.96
65.0	0.98	0.62	0.84	1.05	1.08	1.26	*	*	1.00	0.98
66.2	0.99	0.59	0.81	1.03	1.06	1.25	1.34	*	1.00	0.99
67.0	1.00	0.56	0.78	1.00	1.03	1.22	1.33	*	1.00	1.00
70.0	1.06		0.71	0.93	0.96	1.15	1.30	1.40	1.00	1.06
75.0	1.16			0.74	0.77	0.95	1.17	1.23	1.01	1.15

* = Sensible capacity equals total capacity

Table 12: VT / VR Entering Air Correction Factors - Heating

Ent. Air DB (°F)	Heating Capacity	Power	Heat of Extraction
50.0	1.04	0.81	1.06
55.0	1.03	0.86	1.04
60.0	1.02	0.91	1.03
65.0	1.01	0.95	1.01
68.0	1.00	0.98	1.01
70.0	1.00	1.00	1.00
75.0	0.99	1.05	0.99
80.0	0.98	1.09	0.97

Table 13: VI / VP Electrical Data – Constant Torque EC Motor

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
0204-**B (0.5)	208-230/1/60	2.5	17.7	1	2.2	1/4	208/1/60	0.0	0.0	5.3	15	NA	NA	NA	NA
								1.0	4.8	11.3	15	5.3	15.0	6.0	15
								1.5	7.2	14.3	15	5.3	15.0	9.0	15
								2.0	9.6	17.3	20	5.3	15.0	12.0	15
							230/1/60	0.0	0.0	5.3	15	NA	NA	NA	NA
								1.0	4.3	10.8	15	5.3	15.0	5.4	15
								1.5	6.5	13.5	15	5.3	15.0	8.2	15
								2.0	8.7	16.2	20	5.3	15.0	10.9	15
	265/1/60	2.6	13.5	1	2.2	1/4	265/1/60	0.0	0.0	5.5	15	NA	NA	NA	NA
								1.0	3.8	10.2	15	5.5	15.0	4.7	15
								1.5	5.7	12.5	15	5.5	15.0	7.1	15
								2.0	7.5	14.9	15	5.5	15.0	9.4	15
0304-**B (0.75)	208-230/1/60	5.1	22.0	1	2.2	1/4	208/1/60	0.0	0.0	8.6	15	NA	NA	NA	NA
								1.0	4.8	14.6	15	8.6	15.0	6.0	15
								1.5	7.2	17.6	20	8.6	15.0	9.0	15
								2.0	9.6	20.6	25	8.6	15.0	12.0	15
								2.5	12.0	23.6	25	8.6	15.0	15.0	20
								3.0	14.4	26.6	30	8.6	15.0	18.0	20
							230/1/60	0.0	0.0	8.6	15	NA	NA	NA	NA
								1.0	4.3	14.1	15	8.6	15.0	5.4	15
								1.5	6.5	16.8	20	8.6	15.0	8.2	15
								2.0	8.7	19.5	20	8.6	15.0	10.9	15
								2.5	10.9	22.2	25	8.6	15.0	13.6	15
	265/1/60	4.5	22.0	1	2.2	1/4	265/1/60	3.0	13.0	24.9	25	8.6	15.0	16.3	20
								0.0	0.0	7.8	15	NA	NA	NA	NA
								1.0	3.8	12.5	15	7.8	15.0	4.7	15
								1.5	5.7	14.9	15	7.8	15.0	7.1	15
								2.0	7.5	17.2	20	7.8	15.0	9.4	15
							265/1/60	2.5	9.4	19.6	20	7.8	15.0	11.8	15
								3.0	11.3	22.0	25	7.8	15.0	14.2	15
0404-**B (1.0)	208-230/1/60	6.4	25.0	1	2.2	1/4	208/1/60	0.0	0.0	10.2	15	NA	NA	NA	NA
								1.0	4.8	16.2	20	10.2	15.0	6.0	15
								1.5	7.2	19.2	20	10.2	15.0	9.0	15
								2.0	9.6	22.2	25	10.2	15.0	12.0	15
								2.5	12.0	25.2	30	10.2	15.0	15.0	20
								3.0	14.4	28.2	30	10.2	15.0	18.0	20
								3.5	16.8	NA	NA	10.2	15.0	21.0	25
								4.0	19.2	NA	NA	10.2	15.0	24.0	25
							230/1/60	0.0	0.0	10.2	15	NA	NA	NA	NA
								1.0	4.3	15.7	20	10.2	15.0	5.4	15
								1.5	6.5	18.4	20	10.2	15.0	8.2	15
								2.0	8.7	21.1	25	10.2	15.0	10.9	15
								2.5	10.9	23.8	25	10.2	15.0	13.6	15
								3.0	13.0	26.5	30	10.2	15.0	16.3	20
								3.5	15.2	29.2	30	10.2	15.0	19.0	20
								4.0	17.4	NA	NA	10.2	15.0	21.7	25
	265/1/60	5.1	22.0	1	2.2	1/4	265/1/60	0.0	0.0	8.6	15	NA	NA	NA	NA
								1.0	3.8	13.3	15	8.6	15.0	4.7	15
								1.5	5.7	15.7	20	8.6	15.0	7.1	15
								2.0	7.5	18.0	20	8.6	15.0	9.4	15
								2.5	9.4	20.4	25	8.6	15.0	11.8	15
								3.0	11.3	22.8	25	8.6	15.0	14.2	15
								3.5	13.2	25.1	30	8.6	15.0	16.5	20
								4.0	15.1	27.5	30	8.6	15.0	18.9	20

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
0504-**B (1.25)	208-230/1/60	4.8	26.0	1	2.2	1/4	208/1/60	0.0	0.0	8.2	15	NA	NA	NA	NA
								1.0	4.8	14.2	15	8.2	15.0	6.0	15
								1.5	7.2	17.2	20	8.2	15.0	9.0	15
								2.0	9.6	20.2	25	8.2	15.0	12.0	15
								2.5	12.0	23.2	25	8.2	15.0	15.0	20
								3.0	14.4	26.2	30	8.2	15.0	18.0	20
								3.5	16.8	29.2	30	8.2	15.0	21.0	25
								4.0	19.2	NA	NA	8.2	15.0	24.0	25
								4.5	21.6	NA	NA	8.2	15.0	27.0	30
								5.0	24.0	NA	NA	8.2	15.0	30.0	35
							230/1/60	0.0	0.0	8.2	15	NA	NA	NA	NA
								1.0	4.3	13.6	15	8.2	15.0	5.4	15
								1.5	6.5	16.4	20	8.2	15.0	8.2	15
								2.0	8.7	19.1	20	8.2	15.0	10.9	15
								2.5	10.9	21.8	25	8.2	15.0	13.6	15
								3.0	13.0	24.5	25	8.2	15.0	16.3	20
								3.5	15.2	27.2	30	8.2	15.0	19.0	20
								4.0	17.4	30.0	30	8.2	15.0	21.7	25
								4.5	19.6	NA	NA	8.2	15.0	24.5	25
								5.0	21.7	NA	NA	8.2	15.0	27.2	30
	265/1/60	4.2	25.0	1	2.2	1/4	265/1/60	0.0	0.0	7.4	15	NA	NA	NA	NA
								1.0	3.8	12.1	15	7.4	15.0	4.7	15
								1.5	5.7	14.5	15	7.4	15.0	7.1	15
								2.0	7.5	16.8	20	7.4	15.0	9.4	15
								2.5	9.4	19.2	20	7.4	15.0	11.8	15
								3.0	11.3	21.6	25	7.4	15.0	14.2	15
								3.5	13.2	23.9	25	7.4	15.0	16.5	20
								4.0	15.1	26.3	30	7.4	15.0	18.9	20
								4.5	17.0	28.6	30	7.4	15.0	21.2	25
								5.0	18.9	NA	NA	7.4	15.0	23.6	25

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Electrical Data – Constant Torque EC Motor

VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
0604-**B (1.5)	208-230/1/60	7.7	38.0	1	2.2	1/4	208/1/60	0.0	0.0	11.8	15	NA	NA	NA	NA
								1.0	4.8	17.8	20	11.8	15.0	6.0	15
								1.5	7.2	20.8	25	11.8	15.0	9.0	15
								2.0	9.6	23.8	25	11.8	15.0	12.0	15
								2.5	12.0	26.8	30	11.8	15.0	15.0	20
								3.0	14.4	29.8	30	11.8	15.0	18.0	20
								3.5	16.8	NA	NA	11.8	15.0	21.0	25
								4.0	19.2	NA	NA	11.8	15.0	24.0	25
								4.5	21.6	NA	NA	11.8	15.0	27.0	30
								5.0	24.0	NA	NA	11.8	15.0	30.0	35
								5.5	26.4	NA	NA	11.8	15.0	33.1	35
								6.0	28.8	NA	NA	11.8	15.0	36.1	40
							230/1/60	0.0	0.0	11.8	15	NA	NA	NA	NA
								1.0	4.3	17.3	20	11.8	15.0	5.4	15
								1.5	6.5	20.0	25	11.8	15.0	8.2	15
								2.0	8.7	22.7	25	11.8	15.0	10.9	15
								2.5	10.9	25.4	30	11.8	15.0	13.6	15
								3.0	13.0	28.1	30	11.8	15.0	16.3	20
								3.5	15.2	NA	NA	11.8	15.0	19.0	20
								4.0	17.4	NA	NA	11.8	15.0	21.7	25
								4.5	19.6	NA	NA	11.8	15.0	24.5	25
								5.0	21.7	NA	NA	11.8	15.0	27.2	30
								5.5	23.9	NA	NA	11.8	15.0	29.9	30
								6.0	26.1	NA	NA	11.8	15.0	32.6	35
	265/1/60	7.1	30.0	1	2.2	1/4	265/1/60	0.0	0.0	11.0	15	NA	NA	NA	NA
								1.0	3.8	15.7	20	11.0	15.0	4.7	15
								1.5	5.7	18.1	20	11.0	15.0	7.1	15
								2.0	7.5	20.5	25	11.0	15.0	9.4	15
								2.5	9.4	22.8	25	11.0	15.0	11.8	15
								3.0	11.3	25.2	30	11.0	15.0	14.2	15
								3.5	13.2	27.5	30	11.0	15.0	16.5	20
								4.0	15.1	29.9	30	11.0	15.0	18.9	20
								4.5	17.0	NA	NA	11.0	15.0	21.2	25
								5.0	18.9	NA	NA	11.0	15.0	23.6	25
								5.5	20.8	NA	NA	11.0	15.0	25.9	30
								6.0	22.6	NA	NA	11.0	15.0	28.3	30

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
0804-**B (2.0)	208-230/1/60	10.3	43.0	1	4.6	1/2	208/1/60	0.0	0.0	17.4	25	NA	NA	NA	NA
								1.0	4.8	23.4	30	17.4	25.0	6.0	15
								1.5	7.2	26.4	30	17.4	25.0	9.0	15
								2.0	9.6	29.4	35	17.4	25.0	12.0	15
								2.5	12.0	NA	NA	17.4	25.0	15.0	20
								3.0	14.4	NA	NA	17.4	25.0	18.0	20
								3.5	16.8	NA	NA	17.4	25.0	21.0	25
								4.0	19.2	NA	NA	17.4	25.0	24.0	25
								4.5	21.6	NA	NA	17.4	25.0	27.0	30
								5.0	24.0	NA	NA	17.4	25.0	30.0	35
								5.5	26.4	NA	NA	17.4	25.0	33.1	35
								6.0	28.8	NA	NA	17.4	25.0	36.1	40
								6.5	31.3	NA	NA	17.4	25.0	39.1	40
								7.0	33.7	NA	NA	17.4	25.0	42.1	45
								7.5	36.1	NA	NA	17.4	25.0	45.1	50
								8.0	38.5	NA	NA	17.4	25.0	48.1	50
							230/1/60	0.0	0.0	17.4	25	NA	NA	NA	NA
								1.0	4.3	22.9	30	17.4	25.0	5.4	15
								1.5	6.5	25.6	30	17.4	25.0	8.2	15
								2.0	8.7	28.3	35	17.4	25.0	10.9	15
								2.5	10.9	NA	NA	17.4	25.0	13.6	15
								3.0	13.0	NA	NA	17.4	25.0	16.3	20
								3.5	15.2	NA	NA	17.4	25.0	19.0	20
								4.0	17.4	NA	NA	17.4	25.0	21.7	25
								4.5	19.6	NA	NA	17.4	25.0	24.5	25
								5.0	21.7	NA	NA	17.4	25.0	27.2	30
								5.5	23.9	NA	NA	17.4	25.0	29.9	30
								6.0	26.1	NA	NA	17.4	25.0	32.6	35
								6.5	28.3	NA	NA	17.4	25.0	35.3	40
								7.0	30.4	NA	NA	17.4	25.0	38.0	40
								7.5	32.6	NA	NA	17.4	25.0	40.8	45
								8.0	34.8	NA	NA	17.4	25.0	43.5	45
	265/1/60	8.3	54.0	1	3.2	1/2	265/1/60	0.0	0.0	13.6	20	NA	NA	NA	NA
								1.0	3.8	18.3	25	13.6	20.0	4.7	15
								1.5	5.7	20.7	25	13.6	20.0	7.1	15
								2.0	7.5	23.0	25	13.6	20.0	9.4	15
								2.5	9.4	25.4	30	13.6	20.0	11.8	15
								3.0	11.3	27.7	30	13.6	20.0	14.2	15
								3.5	13.2	NA	NA	13.6	20.0	16.5	20
								4.0	15.1	NA	NA	13.6	20.0	18.9	20
								4.5	17.0	NA	NA	13.6	20.0	21.2	25
								5.0	18.9	NA	NA	13.6	20.0	23.6	25
								5.5	20.8	NA	NA	13.6	20.0	25.9	30
								6.0	22.6	NA	NA	13.6	20.0	28.3	30
								6.5	24.5	NA	NA	13.6	20.0	30.7	35
								7.0	26.4	NA	NA	13.6	20.0	33.0	35
								7.5	28.3	NA	NA	13.6	20.0	35.4	40
								8.0	30.2	NA	NA	13.6	20.0	37.7	40

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
0814-**C (2.0)	208-230/1/60	7.4	43.0	1	4.6	1/2	208/1/60	0.0	0.0	13.9	20	NA	NA	NA	NA
								1.0	4.8	19.9	25	13.9	20.0	6.0	15
								1.5	7.2	22.9	25	13.9	20.0	9.0	15
								2.0	9.6	25.9	30	13.9	20.0	12.0	15
								2.5	12.0	28.9	30	13.9	20.0	15.0	20
								3.0	14.4	NA	NA	13.9	20.0	18.0	20
								3.5	16.8	NA	NA	13.9	20.0	21.0	25
								4.0	19.2	NA	NA	13.9	20.0	24.0	25
								4.5	21.6	NA	NA	13.9	20.0	27.0	30
								5.0	24.0	NA	NA	13.9	20.0	30.0	35
								5.5	26.4	NA	NA	13.9	20.0	33.1	35
								6.0	28.8	NA	NA	13.9	20.0	36.1	40
								6.5	31.3	NA	NA	13.9	20.0	39.1	40
								7.0	33.7	NA	NA	13.9	20.0	42.1	45
								7.5	36.1	NA	NA	13.9	20.0	45.1	50
								8.0	38.5	NA	NA	13.9	20.0	48.1	50
							230/1/60	0.0	0.0	13.9	20	NA	NA	NA	NA
								1.0	4.3	19.3	25	13.9	20.0	5.4	15
								1.5	6.5	22.0	25	13.9	20.0	8.2	15
								2.0	8.7	24.7	25	13.9	20.0	10.9	15
								2.5	10.9	27.4	30	13.9	20.0	13.6	15
								3.0	13.0	NA	NA	13.9	20.0	16.3	20
								3.5	15.2	NA	NA	13.9	20.0	19.0	20
								4.0	17.4	NA	NA	13.9	20.0	21.7	25
								4.5	19.6	NA	NA	13.9	20.0	24.5	25
								5.0	21.7	NA	NA	13.9	20.0	27.2	30
								5.5	23.9	NA	NA	13.9	20.0	29.9	30
								6.0	26.1	NA	NA	13.9	20.0	32.6	35
								6.5	28.3	NA	NA	13.9	20.0	35.3	40
								7.0	30.4	NA	NA	13.9	20.0	38.0	40
								7.5	32.6	NA	NA	13.9	20.0	40.8	45
								8.0	34.8	NA	NA	13.9	20.0	43.5	45
	265/1/60	6.7	46.0	1	3.2	1/2	265/1/60	0.0	0.0	11.6	15	NA	NA	NA	NA
								1.0	3.8	16.3	20	11.6	15.0	4.7	15
								1.5	5.7	18.7	20	11.6	15.0	7.1	15
								2.0	7.5	21.0	25	11.6	15.0	9.4	15
								2.5	9.4	23.4	25	11.6	15.0	11.8	15
								3.0	11.3	25.7	30	11.6	15.0	14.2	15
								3.5	13.2	28.1	30	11.6	15.0	16.5	20
								4.0	15.1	NA	NA	11.6	15.0	18.9	20
								4.5	17.0	NA	NA	11.6	15.0	21.2	25
								5.0	18.9	NA	NA	11.6	15.0	23.6	25
								5.5	20.8	NA	NA	11.6	15.0	25.9	30
								6.0	22.6	NA	NA	11.6	15.0	28.3	30
								6.5	24.5	NA	NA	11.6	15.0	30.7	35
								7.0	26.4	NA	NA	11.6	15.0	33.0	35
								7.5	28.3	NA	NA	11.6	15.0	35.4	40
								8.0	30.2	NA	NA	11.6	15.0	37.7	40

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
1004-**C (2.5)	208-230/1/60	14.1	73.0	1	4.6	1/2	208/1/60	0.0	0.0	22.2	35	NA	NA	NA	NA
								1.0	4.8	28.2	40	22.2	35.0	6.0	15
								1.5	7.2	NA	NA	22.2	35.0	9.0	15
								2.0	9.6	NA	NA	22.2	35.0	12.0	15
								2.5	12.0	NA	NA	22.2	35.0	15.0	20
								3.0	14.4	NA	NA	22.2	35.0	18.0	20
								3.5	16.8	NA	NA	22.2	35.0	21.0	25
								4.0	19.2	NA	NA	22.2	35.0	24.0	25
								4.5	21.6	NA	NA	22.2	35.0	27.0	30
								5.0	24.0	NA	NA	22.2	35.0	30.0	35
								5.5	26.4	NA	NA	22.2	35.0	33.1	35
								6.0	28.8	NA	NA	22.2	35.0	36.1	40
								6.5	31.3	NA	NA	22.2	35.0	39.1	40
								7.0	33.7	NA	NA	22.2	35.0	42.1	45
								7.5	36.1	NA	NA	22.2	35.0	45.1	50
								8.0	38.5	NA	NA	22.2	35.0	48.1	50
								8.5	40.9	NA	NA	22.2	35.0	51.1	55
								9.0	43.3	NA	NA	22.2	35.0	54.1	55
								9.5	45.7	NA	NA	22.2	35.0	57.1	60
								10.0	48.1	NA	NA	22.2	35.0	60.1	65
							230/1/60	0.0	0.0	22.2	35	NA	NA	NA	NA
								1.0	4.3	27.7	40	22.2	35.0	5.4	15
								1.5	6.5	NA	NA	22.2	35.0	8.2	15
								2.0	8.7	NA	NA	22.2	35.0	10.9	15
								2.5	10.9	NA	NA	22.2	35.0	13.6	15
								3.0	13.0	NA	NA	22.2	35.0	16.3	20
								3.5	15.2	NA	NA	22.2	35.0	19.0	20
								4.0	17.4	NA	NA	22.2	35.0	21.7	25
								4.5	19.6	NA	NA	22.2	35.0	24.5	25
								5.0	21.7	NA	NA	22.2	35.0	27.2	30
								5.5	23.9	NA	NA	22.2	35.0	29.9	30
								6.0	26.1	NA	NA	22.2	35.0	32.6	35
								6.5	28.3	NA	NA	22.2	35.0	35.3	40
								7.0	30.4	NA	NA	22.2	35.0	38.0	40
								7.5	32.6	NA	NA	22.2	35.0	40.8	45
								8.0	34.8	NA	NA	22.2	35.0	43.5	45
								8.5	37.0	NA	NA	22.2	35.0	46.2	50
								9.0	39.1	NA	NA	22.2	35.0	48.9	50
								9.5	41.3	NA	NA	22.2	35.0	51.6	55
								10.0	43.5	NA	NA	22.2	35.0	54.3	55

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
1004-**C (2.5)	265/1/60	11.2	60.0	1	3.2	1/2	265/1/60	0.0	0.0	17.2	25	NA	NA	NA	NA
								1.0	3.8	21.9	30	17.2	25.0	4.7	15
								1.5	5.7	24.3	30	17.2	25.0	7.1	15
								2.0	7.5	26.6	35	17.2	25.0	9.4	15
								2.5	9.4	29.0	35	17.2	25.0	11.8	15
								3.0	11.3	NA	NA	17.2	25.0	14.2	15
								3.5	13.2	NA	NA	17.2	25.0	16.5	20
								4.0	15.1	NA	NA	17.2	25.0	18.9	20
								4.5	17.0	NA	NA	17.2	25.0	21.2	25
								5.0	18.9	NA	NA	17.2	25.0	23.6	25
								5.5	20.8	NA	NA	17.2	25.0	25.9	30
								6.0	22.6	NA	NA	17.2	25.0	28.3	30
								6.5	24.5	NA	NA	17.2	25.0	30.7	35
								7.0	26.4	NA	NA	17.2	25.0	33.0	35
								7.5	28.3	NA	NA	17.2	25.0	35.4	40
								8.0	30.2	NA	NA	17.2	25.0	37.7	40
								8.5	32.1	NA	NA	17.2	25.0	40.1	45
								9.0	34.0	NA	NA	17.2	25.0	42.5	45
								9.5	35.8	NA	NA	17.2	25.0	44.8	45
								10.0	37.7	NA	NA	17.2	25.0	47.2	50

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
1204-**C (3.0)	208-230/1/60	14.1	77.0	1	4.6	1/2	208/1/60	0.0	0.0	22.2	35	NA	NA	NA	NA
								1.0	4.8	28.2	40	22.2	35.0	6.0	15
								1.5	7.2	NA	NA	22.2	35.0	9.0	15
								2.0	9.6	NA	NA	22.2	35.0	12.0	15
								2.5	12.0	NA	NA	22.2	35.0	15.0	20
								3.0	14.4	NA	NA	22.2	35.0	18.0	20
								3.5	16.8	NA	NA	22.2	35.0	21.0	25
								4.0	19.2	NA	NA	22.2	35.0	24.0	25
								4.5	21.6	NA	NA	22.2	35.0	27.0	30
								5.0	24.0	NA	NA	22.2	35.0	30.0	35
								5.5	26.4	NA	NA	22.2	35.0	33.1	35
								6.0	28.8	NA	NA	22.2	35.0	36.1	40
								6.5	31.3	NA	NA	22.2	35.0	39.1	40
								7.0	33.7	NA	NA	22.2	35.0	42.1	45
								7.5	36.1	NA	NA	22.2	35.0	45.1	50
								8.0	38.5	NA	NA	22.2	35.0	48.1	50
								8.5	40.9	NA	NA	22.2	35.0	51.1	55
								9.0	43.3	NA	NA	22.2	35.0	54.1	55
								9.5	45.7	NA	NA	22.2	35.0	57.1	60
								10.0	48.1	NA	NA	22.2	35.0	60.1	65
							230/1/60	0.0	0.0	22.2	35	NA	NA	NA	NA
								1.0	4.3	27.7	40	22.2	35.0	5.4	15
								1.5	6.5	NA	NA	22.2	35.0	8.2	15
								2.0	8.7	NA	NA	22.2	35.0	10.9	15
								2.5	10.9	NA	NA	22.2	35.0	13.6	15
								3.0	13.0	NA	NA	22.2	35.0	16.3	20
								3.5	15.2	NA	NA	22.2	35.0	19.0	20
								4.0	17.4	NA	NA	22.2	35.0	21.7	25
								4.5	19.6	NA	NA	22.2	35.0	24.5	25
								5.0	21.7	NA	NA	22.2	35.0	27.2	30
								5.5	23.9	NA	NA	22.2	35.0	29.9	30
								6.0	26.1	NA	NA	22.2	35.0	32.6	35
								6.5	28.3	NA	NA	22.2	35.0	35.3	40
								7.0	30.4	NA	NA	22.2	35.0	38.0	40
								7.5	32.6	NA	NA	22.2	35.0	40.8	45
								8.0	34.8	NA	NA	22.2	35.0	43.5	45
								8.5	37.0	NA	NA	22.2	35.0	46.2	50
								9.0	39.1	NA	NA	22.2	35.0	48.9	50
								9.5	41.3	NA	NA	22.2	35.0	51.6	55
								10.0	43.5	NA	NA	22.2	35.0	54.3	55

VI / VP Electrical Data – Constant Torque EC Motor (cont'd.)

Size (Tons)	Compressor				Supply Blower Motor		Electric Heat			Single Point Power		Dual Point Power			
	Voltage		LRA	QTY	FLA	HP	Voltage	kW	Amps	MCA	MOPD	Unit MCA	Unit MOPD	E-Heat MCA	E-Heat MOPD
1204-**C (3.0)	265/1/60	12.2	72.0	1	3.2	1/2	265/1/60	0.0	0.0	18.5	30	NA	NA	NA	NA
								1.0	3.8	23.2	30	18.5	30.0	4.7	15
								1.5	5.7	25.5	35	18.5	30.0	7.1	15
								2.0	7.5	27.9	35	18.5	30.0	9.4	15
								2.5	9.4	NA	NA	18.5	30.0	11.8	15
								3.0	11.3	NA	NA	18.5	30.0	14.2	15
								3.5	13.2	NA	NA	18.5	30.0	16.5	20
								4.0	15.1	NA	NA	18.5	30.0	18.9	20
								4.5	17.0	NA	NA	18.5	30.0	21.2	25
								5.0	18.9	NA	NA	18.5	30.0	23.6	25
								5.5	20.8	NA	NA	18.5	30.0	25.9	30
								6.0	22.6	NA	NA	18.5	30.0	28.3	30
								6.5	24.5	NA	NA	18.5	30.0	30.7	35
								7.0	26.4	NA	NA	18.5	30.0	33.0	35
								7.5	28.3	NA	NA	18.5	30.0	35.4	40
								8.0	30.2	NA	NA	18.5	30.0	37.7	40
								8.5	32.1	NA	NA	18.5	30.0	40.1	45
								9.0	34.0	NA	NA	18.5	30.0	42.5	45
								9.5	35.8	NA	NA	18.5	30.0	44.8	45
								10.0	37.7	NA	NA	18.5	30.0	47.2	50


The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

**Table 14: Additional Static Resistance (Inches of Water Column)**







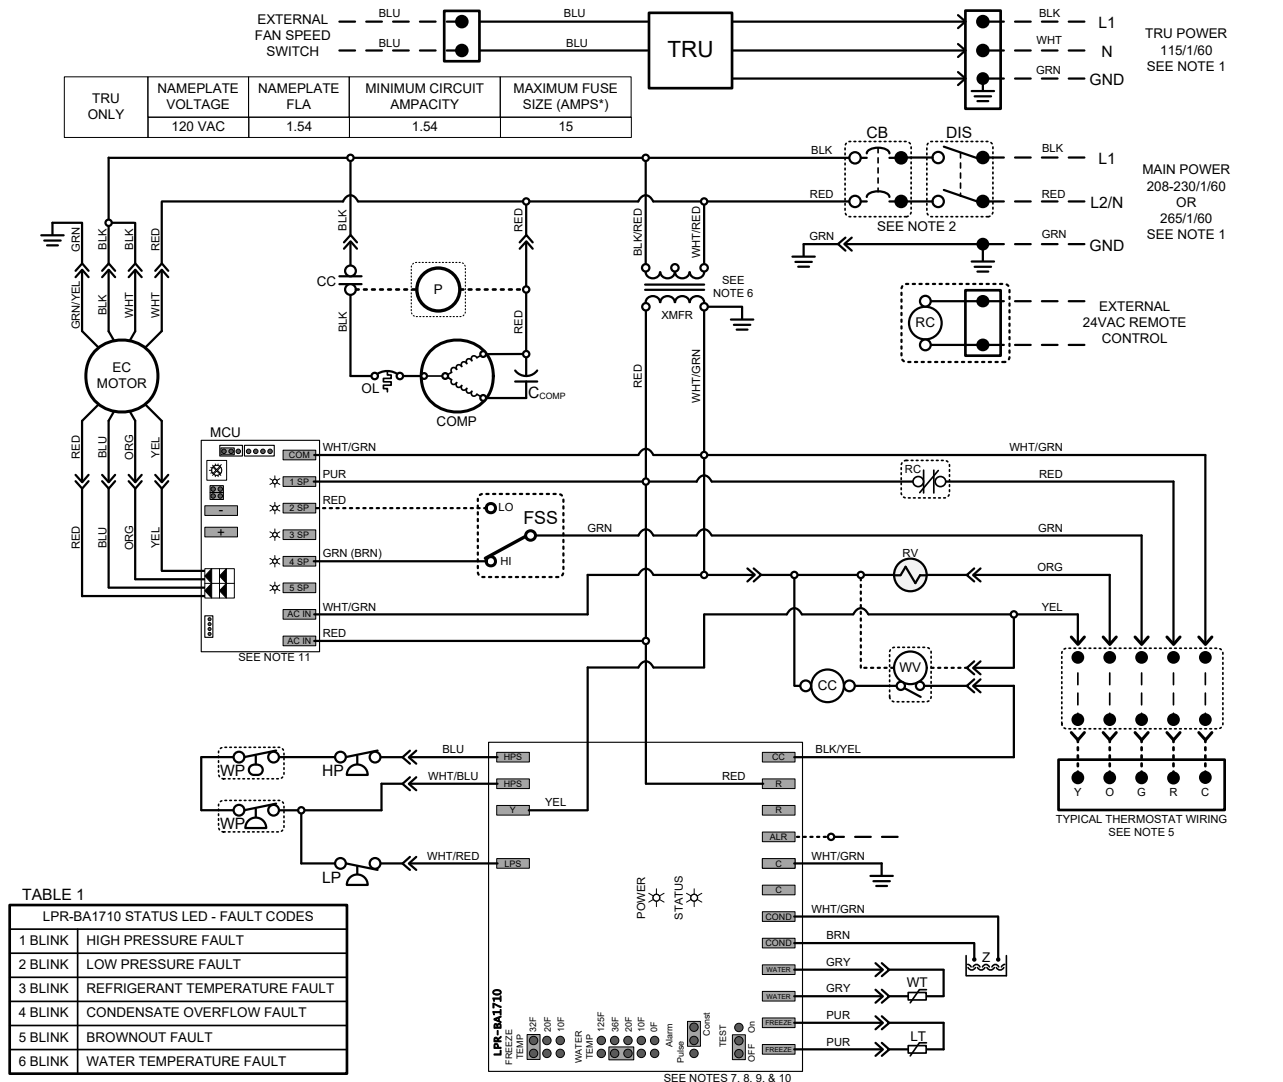









Size (Tons)	Model	Fan Speed	Filter ¹				
			MERV 4 (Fiberglass)	MERV 4 (Poly)	MERV 8	MERV 11	MERV 13
0204 (0.5)	VP-C	High	0.02	0.03	0.08	0.10	0.09
		Low	0.02	0.03	0.08	0.09	0.08
0304 (0.75)		High	0.02	0.03	0.08	0.09	0.09
		Low	0.01	0.02	0.05	0.06	0.05
0404 (1.0)		High	0.04	0.05	0.13	0.14	0.14
		Low	0.02	0.03	0.09	0.10	0.10
0504 (1.25)		High	0.03	0.04	0.11	0.12	0.11
		Low	0.02	0.02	0.07	0.08	0.07
0604 (1.5)		High	0.04	0.06	0.14	0.15	0.15
		Low	0.03	0.04	0.10	0.11	0.11
0804 (2.0)		High	0.07	0.10	0.22	0.22	0.26
		Low	0.05	0.07	0.17	0.17	0.19
0814 (2.0)		High	0.02	0.03	0.09	0.10	0.10
		Low	0.02	0.02	0.07	0.08	0.07
1004 (2.5)		High	0.03	0.05	0.11	0.12	0.13
		Low	0.02	0.03	0.09	0.10	0.09
1204 (3.0)		High	0.05	0.07	0.16	0.16	0.18
		Low	0.03	0.05	0.12	0.13	0.13

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Wiring Diagram: 0204-0604: 2 Speed EC Motor



LEGEND:

- | | | |
|--|---|----------------------------------|
| CC - COMPRESSOR CONTACTOR |  | - FACTORY WIRING |
| C _{COMP} - COMPRESSOR CAPACITOR |  | - FIELD WIRING |
| MCU - FAN MOTOR CONTROLLER |  | - OPTIONAL WIRING/ACCESSORY |
| RV - REVERSING VALVE |  | - QUICK CONNECTION |
| HP - HIGH PRESSURE LIMIT |  | - FACTORY CONNECTION |
| LT - LOW TEMPERATURE LIMIT |  | - FIELD CONNECTION |
| XFMR - 24VAC TRANSFORMER; 40 VA |  | - LIGHT EMITTING DIODE INDICATOR |
| OL - COMPRESSOR OVERLOAD (See Note 4) |  | - HIGH PRESSURE SWITCH |
| Z - CONDENSATE OVERFLOW SENSOR |  | - LOW PRESSURE SWITCH |
| WT - WATER TEMPERATURE LIMIT |  | - THERMISTOR |
| LP - LOW PRESSURE LIMIT |  | - CONDENSATE DRAIN PAN |
| WV - WATER CONTROL VALVE (See Note 12) |  | - RELAY COIL |
| WP - WATER PRESSURE LIMIT |  | - NORMALLY OPEN RELAY CONTACTS |
| P - INLINE CIRCULATING PUMP |  | - NORMALLY CLOSED RELAY CONTACTS |
| RC - REMOTE CONTROL RELAY |  | - SOLENOID COIL |
| DIS - DISCONNECT SWITCH |  | - GROUND CONNECTION |
| CB - CIRCUIT BREAKER (See Note 3) | | |
| FSS - FAN SPEED SWITCH | | |

NOTES:

1. Use copper conductors only.
2. DPST switch for 208V applications only.
3. If used, CB replaces DIS.
4. OL may be internal or external to compressor depending on unit size.
5. Thermostat is field installed and may be remote mounted.
6. For 208-230V units, transformer is factory wired for operation at 230V. For 208V operation, move lead to 208V terminal.
7. STATUS LED blinks to indicate fault; reference Table 1 for fault condition
8. FREEZE TEMP jumper shown in default location. When using antifreeze fluid mixture, refer to IOM for correct setting.
9. WATER TEMP jumper shown in bypass position when WT sensor is not equipped. When WT sensor is equipped, refer to IOM for correct fluid mixture protection setting.
10. TEST mode is for diagnostic purposes only. When ON, anti-short cycle protection is reduced from 300 seconds to 5 seconds. After board has been powered for 60 minutes in TEST mode, normal operation is resumed; regardless of jumper position. Cycling unit power will reset operation.
11. MCU shown with typical fan speed connections. Actual speeds may vary by unit size.
12. If equipped, water valve contains end switch.

6 A11GS1f TR ULF.vsd

7 July, 2017

[illegible]

- CC - COMPRESSOR CONTACTOR
- C_{COMP} - COMPRESSOR CAPACITOR
- MCU - FAN MOTOR CONTROLLER
- RV - REVERSING VALVE
- HP - HIGH PRESSURE LIMIT
- LT - LOW TEMPERATURE LIMIT
- XFMR - 24VAC TRANSFORMER; 40 VA
- OL - COMPRESSOR OVERLOAD (See Note 4)
- ZL - CONDENSATE OVERFLOW SENSOR
- WT - WATER TEMPERATURE LIMIT
- LP - LOW PRESSURE LIMIT
- LV - WATER CONTROL VALVE (See Note 12)
- WP - WATER PRESSURE LIMIT
- P - INLINE CIRCULATING PUMP
- RC - REMOTE CONTROL RELAY
- DIS - DISCONNECT SWITCH
- CB - CIRCUIT BREAKER (See Note 3)
- FSS - FAN SPEED SWITCH


1. Use copper conductors only.
2. DPST switch for 208V applications only.
3. If used, CB replaces DIS
4. OL may be internal or external to compressor depending on unit size.
5. Thermostat is field installed and may be remote mounted.
6. For 208-230V units, transformer is factory wired for operation at 230V.
For 208V operation, move lead to 208V terminal.
7. STATUS LED blinks to indicate fault; reference Table 1 for fault condition
8. FREEZE TEMP jumper shown in default location. When using antifreeze fluid mixture, refer to IOM for correct setting.
9. WATER TEMP jumper shown in bypass position when WT sensor is not equipped. When WT sensor is equipped, refer to IOM for correct fluid mixture protection setting.
10. TEST mode is for diagnostic purposes only. When ON, anti-short cycle protection is reduced from 300 seconds to 5 seconds. After board has been powered for 60 minutes in TEST mode, normal operation is resumed; regardless of jumper position. Cycling unit power will reset operation.
11. (Left empty intentionally)
12. If equipped, water valve contains end switch .

Whispertherm® Series with Whisperpack® Chassis Product Design Guide

Whispertherm® Standard Riser & TRU Details

EA = EXHAUST AIR (TO OUTSIDE)
 IA = INTAKE AIR (FROM OUTSIDE)
 RA = RECOVERY AIR (FROM WASHROOM)

ALL WITH 5" ROUND DUCT COLLARS

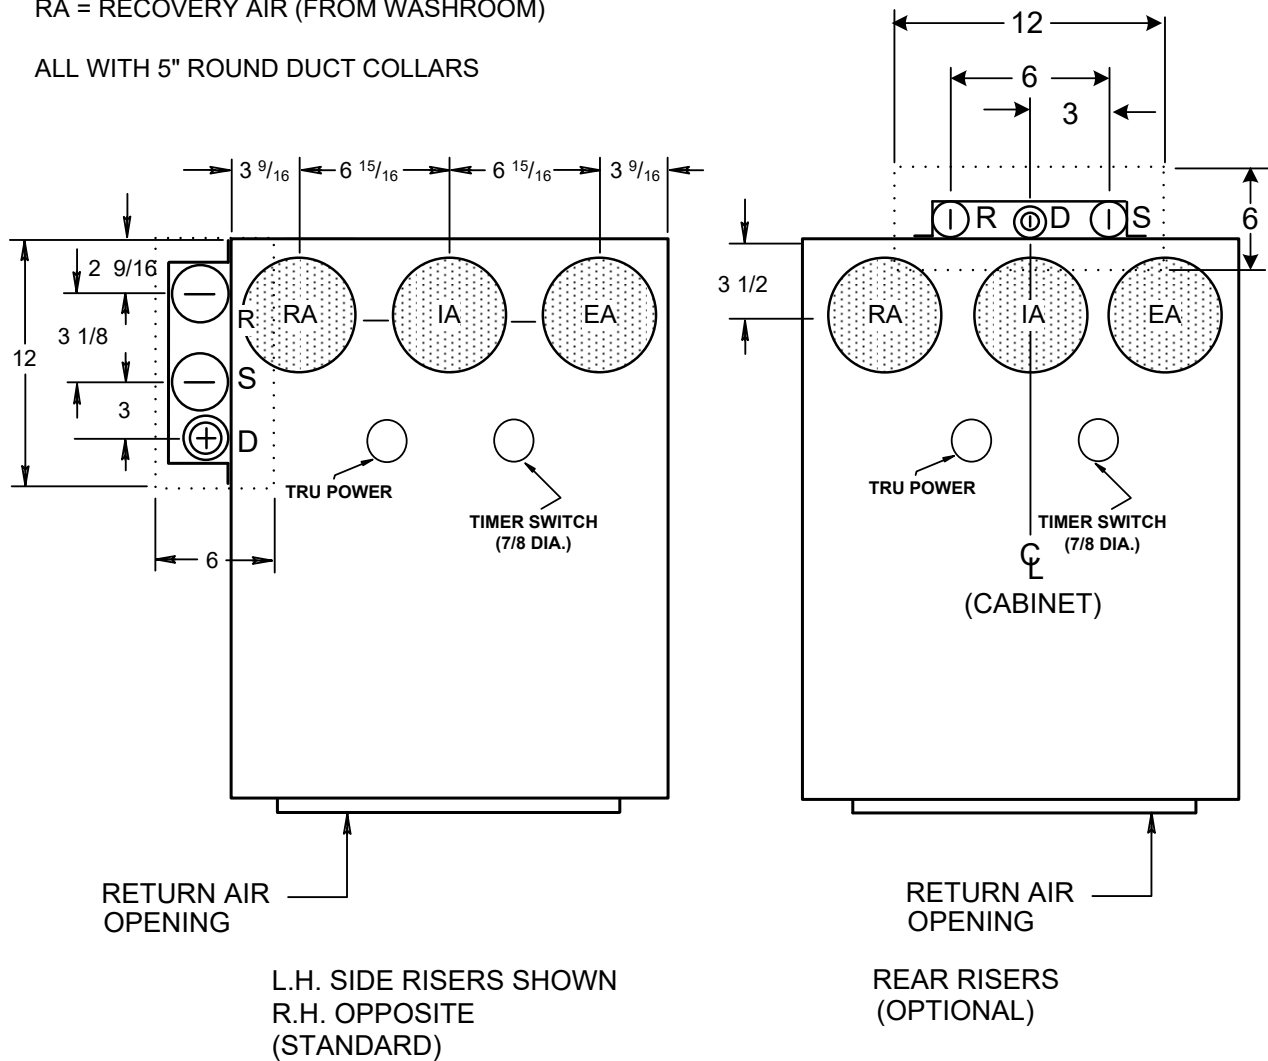

Notes:

1. Risers are protected by a steel riser cover extending the height of the cabinet. Risers are soldered to a copper clamp to help prevent movement during shipment and jobsite handling.
2. Riser couplings are not furnished by Whalen, unless otherwise noted.
3. Sleeve hole dimensions are recommended minimums.
4. Supply riser is always towards the R.A. (front) on side riser units and to the right on rear riser units as indicated on drawing.

RISER SIZE **		
OPTION	No Insulation	1/2" Insulation
STANDARD	2 1/2	1 1/2

** RISER SIZE REFERS TO THE LARGEST RISER ON PROJECT.


DRAWING NUMBER 609g-PT-ITR
 OCTOBER 2021

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com




EA = EXHAUST AIR (TO OUTSIDE)
IA = INTAKE AIR (FROM OUTSIDE)
RA = RECOVERY AIR (FROM WASHROOM)

ALL WITH 5" ROUND DUCT COLLARS

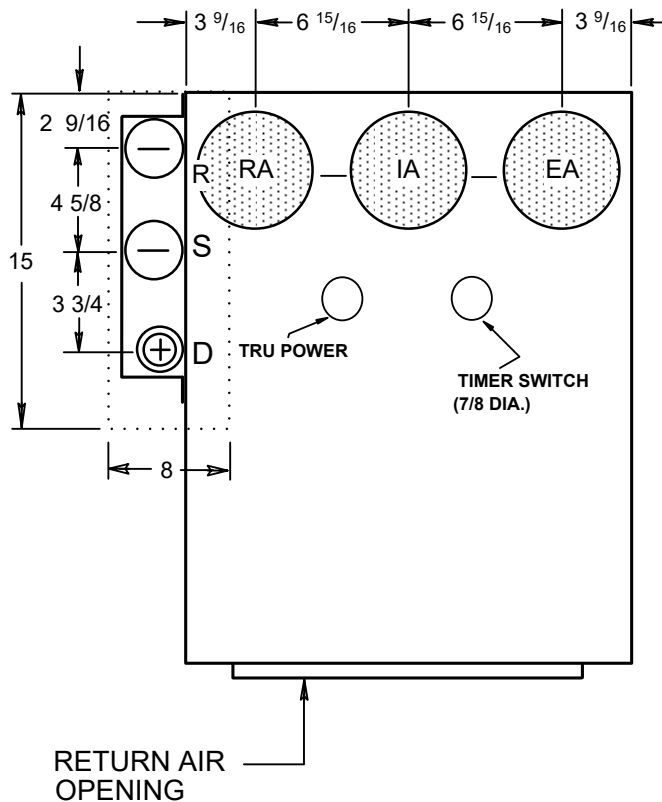

L.H. SIDE RISERS SHOWN
R.H. OPPOSITE
(STANDARD)

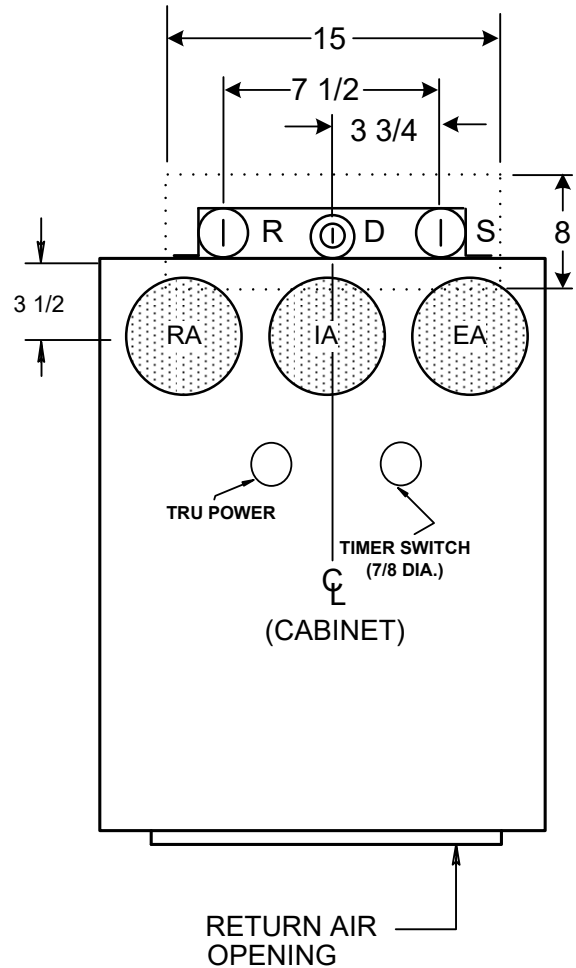

REAR RISERS
(OPTIONAL)

Notes:

1. Risers are protected by a steel riser cover extending the height of the cabinet. Risers are soldered to a copper clamp to help prevent movement during shipment and jobsite handling.
2. Riser couplings are not furnished by Whalen, unless otherwise noted.
3. Sleeve hole dimensions are recommended minimums.
4. Supply riser is always towards the R.A. (front) on side riser units and to the right on rear riser units as indicated on drawing.

RISER SIZE **		
OPTION	No Insulation	1/2" Insulation
EXTENDED	4	3


** RISER SIZE REFERS TO THE LARGEST RISER ON PROJECT.

DRAWING NUMBER 609g-PT-ITR-EXT
OCTOBER 2021


Whispertherm® Split Riser & TRU Details

EA = EXHAUST AIR (TO OUTSIDE)
 IA = INTAKE AIR (FROM OUTSIDE)
 RA = RECOVERY AIR (FROM WASHROOM)

ALL WITH 5" ROUND DUCT COLLARS

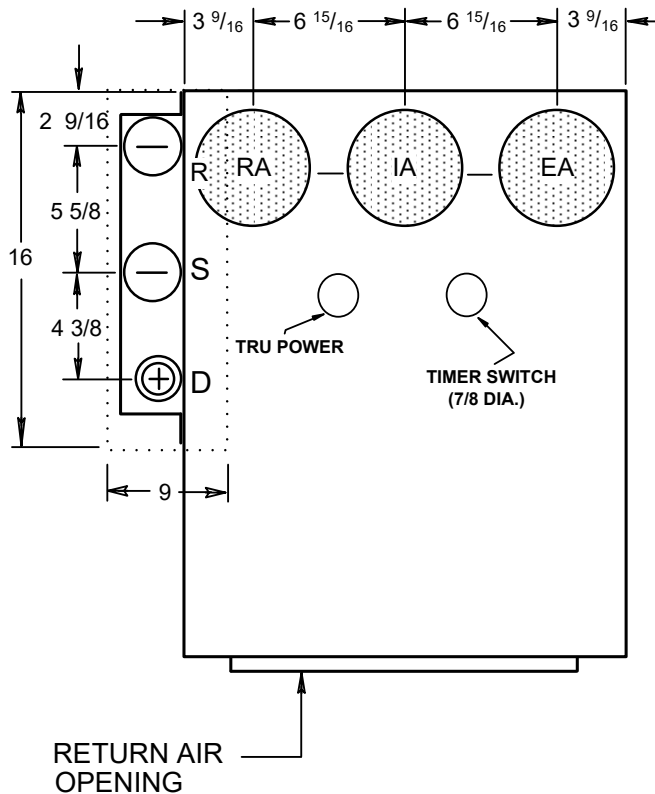

L.H. SIDE RISERS SHOWN
 R.H. OPPOSITE
 (STANDARD)

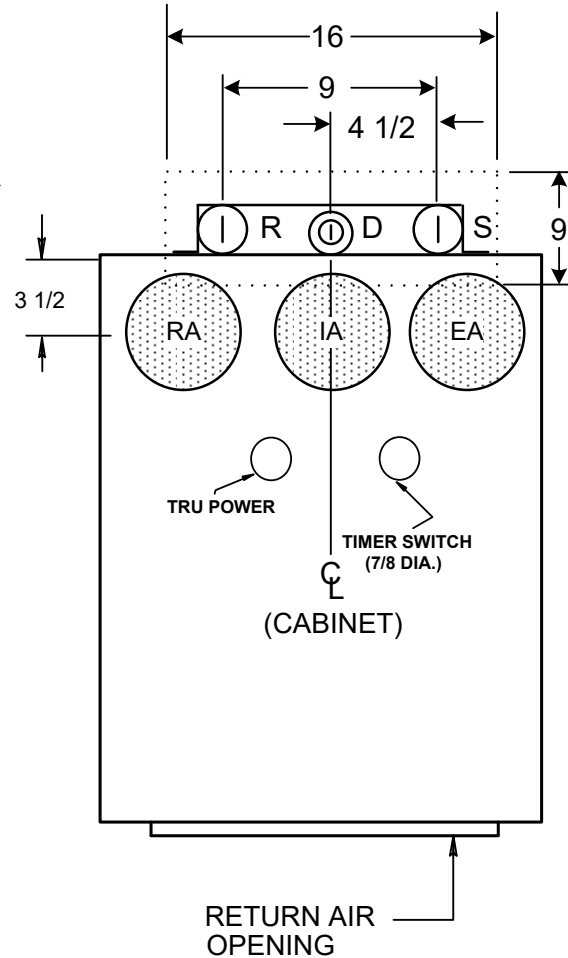

REAR RISERS
 (OPTIONAL)

Notes:

1. Risers are protected by a steel riser cover extending the height of the cabinet. Risers are soldered to a copper clamp to help prevent movement during shipment and jobsite handling.
2. Riser couplings are not furnished by Whalen, unless otherwise noted.
3. Sleeve hole dimensions are recommended minimums.
4. Supply riser is always towards the R.A. (front) on side riser units and to the right on rear riser units as indicated on drawing.

RISER SIZE **		
OPTION	No Insulation	1/2" Insulation
SPLIT	4	4

** RISER SIZE REFERS TO THE LARGEST RISER ON PROJECT.


DRAWING NUMBER 609g-PT-ITR-SPLIT
 OCTOBER 2021

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



EA = EXHAUST AIR (TO OUTSIDE)
IA = INTAKE AIR (FROM OUTSIDE)
RA = RECOVERY AIR (FROM WASHROOM)


ALL WITH 5" ROUND DUCT COLLARS

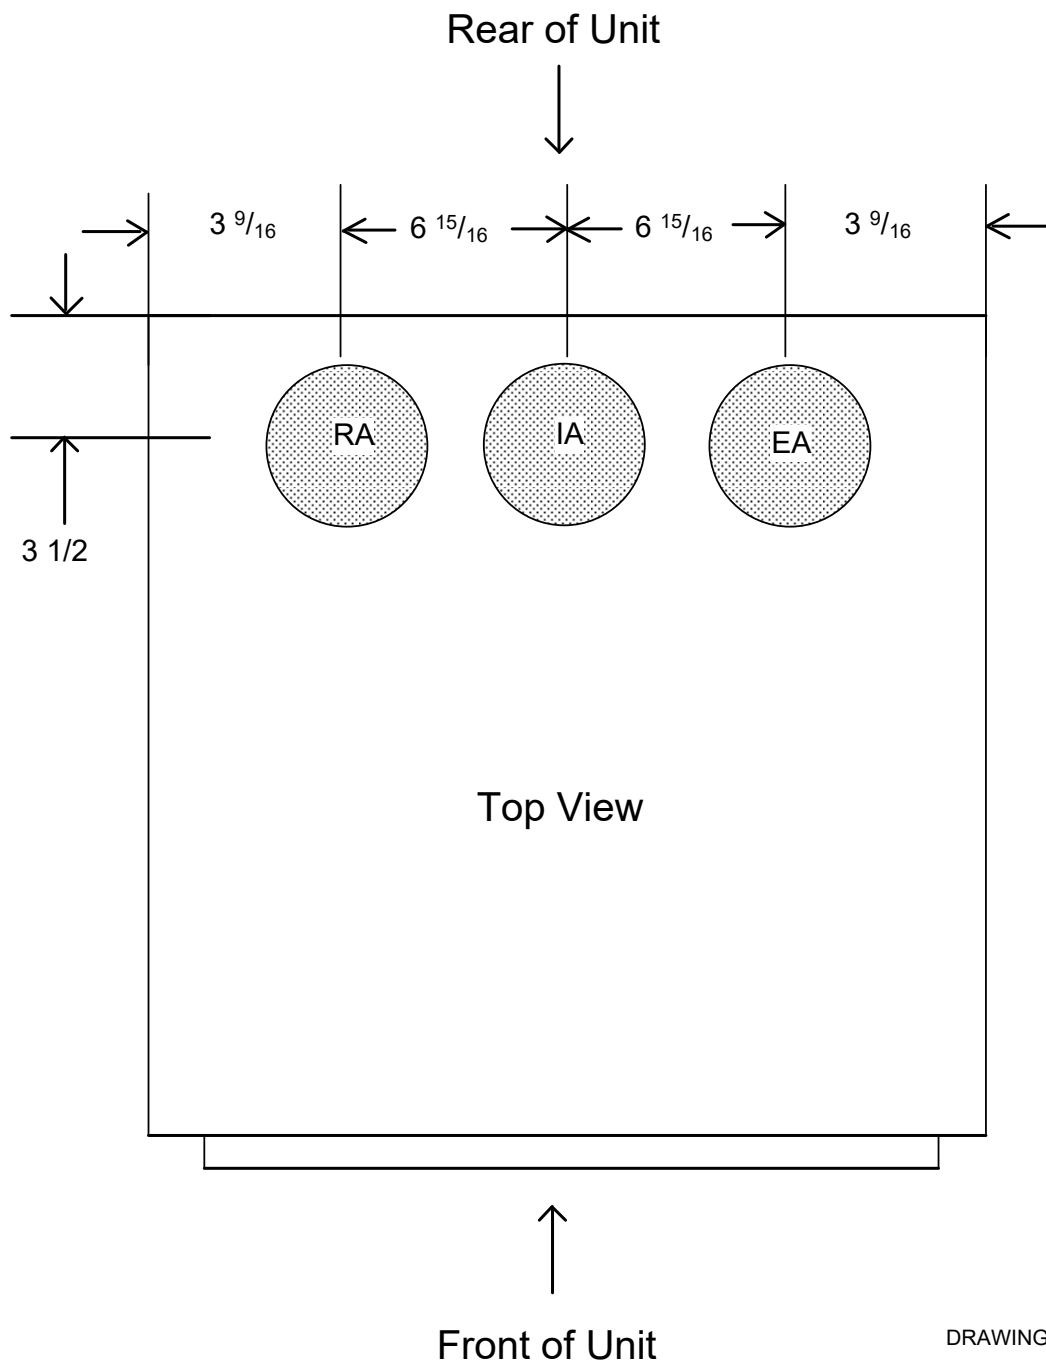


DRAWING NUMBER 622e-ITR
JANUARY 2020

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com


Whispertherm® Supply Grille Discharge Arrangements




**TYPE F
(FRONT)**




**TYPE F
(FRONT)**

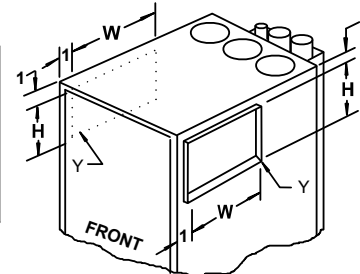


**TYPE L-R
(LEFT-RIGHT)
CAN ONLY BE USED WITH
REAR RISERS**

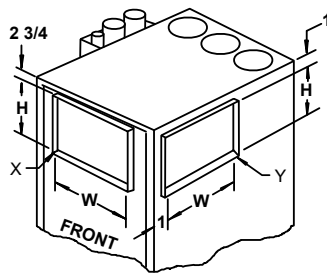

**TYPE F-R
(FRONT & RIGHT)
RISERS MUST BE SIDE OPPOSITE
SUPPLY DISCHARGE**



**TYPE T
(TOP DUCTED)**

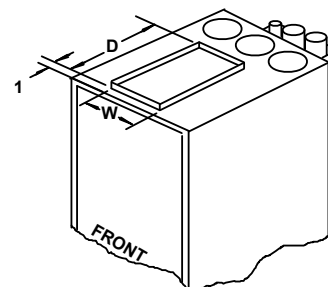

**TYPE T
(TOP DUCTED)**

**LH SIDE RISER UNITS SHOWN ABOVE
(RH OPPOSITE)**

REAR RISER UNITS SHOWN ABOVE

Notes:

1. All Whalen supply grilles are fabricated of anodized aluminum and painted white.
2. See unit schedule for discharge types.
3. Supply grilles are shipped loose for installation after drywall installation is complete.
4. Listed grille dimensions are for the grille opening size.
5. All front and top grilles are centered on the unit.
6. Unless otherwise noted, the grille blades will be vertical.
7. Registers must not be used.
8. Where Type T is combined with Type F, L or R, grille height will be that of a two-grille discharge.
9. For top ducted units see drawing number 622-ITR for alternate TRU connections.
10. For units with side risers and a side supply discharge, supply must be side opposite risers.

UNIT SIZE	GRILLE	1 Grille Type (F,B,L,R)		2 Grille Type (F-B, F-L, F-R, L-R, B-L, B-R)		Top Ducted Type (T)	
		W	H	W	H	W	D
0204		10	8	10	4	12	10
0304		14	8	14	6	12	10
0404		14	10	14	6	12	12
0504		16	12	16	6	14	14
0604		16	12	16	6	14	14
0804		16	16	16	8	14	16
0814	X	16	16	16	8	14	16
	Y			8	18		
1004	X	Not Available		16	14	14	16
	Y			10	18		
1204	X	Not Available		16	16	14	16
	Y			10	20		

DRAWING NUMBER 611e -ITR


All dimensions in inches.

OCTOBER 2021

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Whispertherm® Units with Top Connections - Rear Risers - Unit Sizes 0204-0804

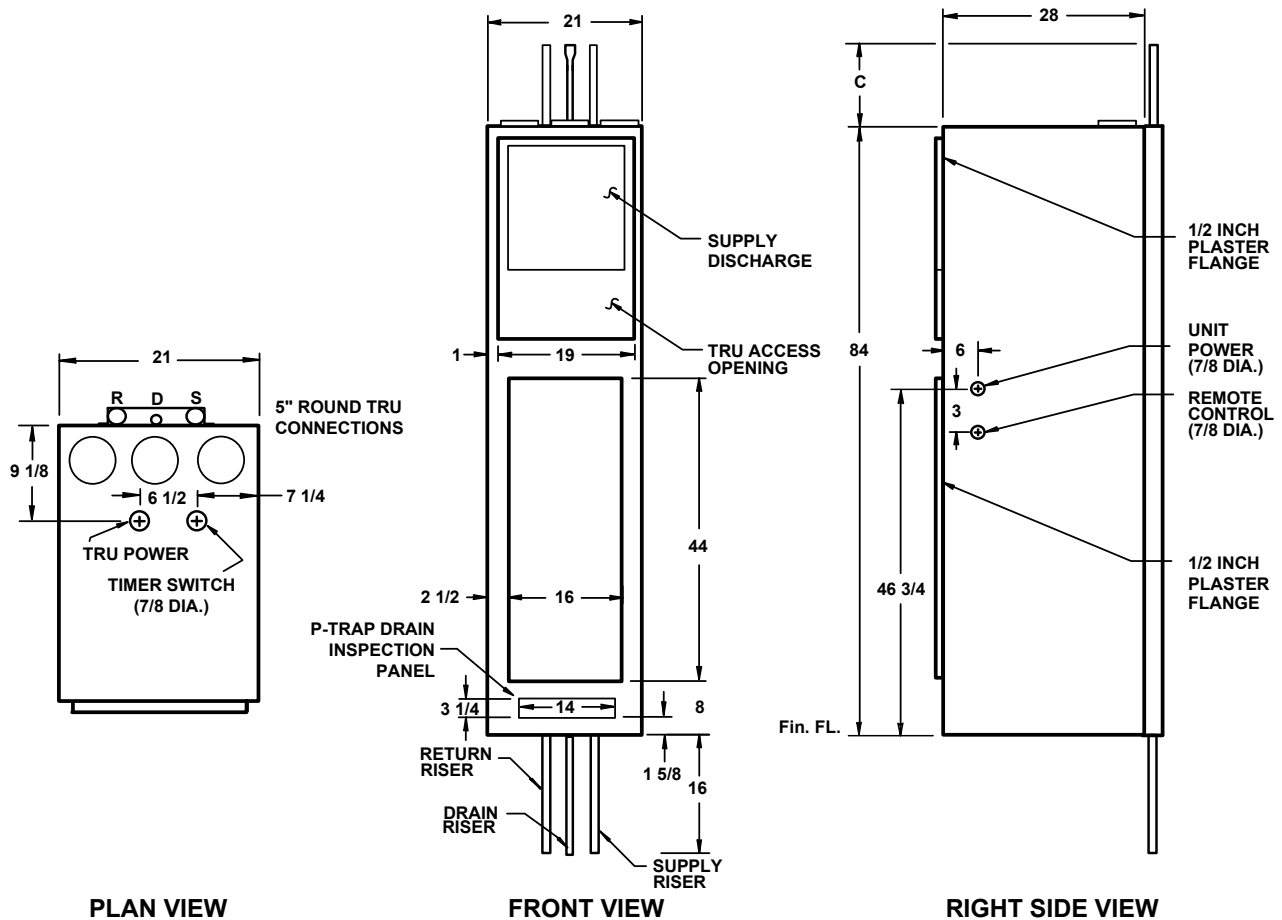

Notes:

1. The return air opening is always on the front of the unit.
2. Cabinet is acoustically and thermally insulated, and is fabricated of galvanized steel.
3. Supply, return and drain risers are type M copper. Riser assemblies include two shut off valves inside the cabinet. Standard units include high-pressure hose kits for connection of the refrigeration chassis or hydronic chassis.
4. See drawing 609-PT-ITR for plan view.
5. Fan motor is constant-torque ECM type. With no heat/cool demand, fan will operate constantly on ultra Low speed.
6. TRU maximum exhaust = 162 CFM intermittent. TRU maximum ventilation = 95 CFM constant.
7. Side unit power and remote control are always side opposite riser.


RISER LENGTH	C
9 FOOT	8
10 FOOT	20

All dimensions in inches.

DRAWING NUMBER 602e-PT-ITR-R
OCTOBER 2021

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Whispertherm® Units with Top Connections - Rear Risers - Unit Sizes 0814-1204

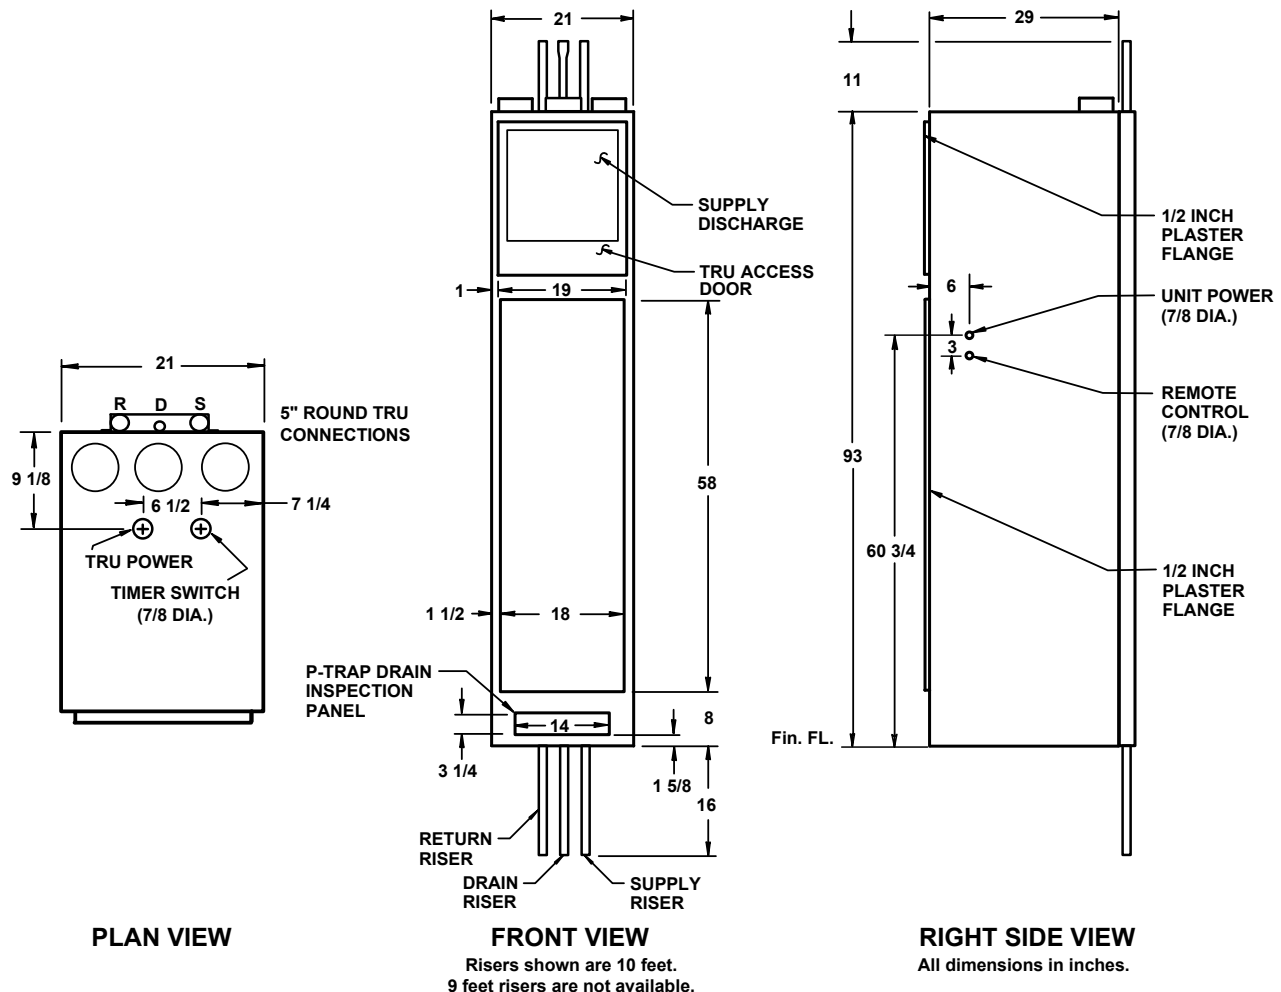

Notes:


1. The return air opening is always on the front of the unit.
2. Cabinet is acoustically and thermally insulated, and is fabricated of galvanized steel.
3. Supply, return and drain risers are type M copper. Riser assemblies include two shut off valves inside the cabinet. Standard units include high-pressure hose kits for connection of the refrigeration chassis or hydronic chassis.
4. See drawing 609-PT-ITR for plan view.
5. Fan motor is constant-torque ECM type. With no heat/cool demand, fan will operate constantly on ultra Low speed.
6. TRU maximum exhaust = 162 CFM intermittent. TRU maximum ventilation = 95 CFM constant.
7. Side unit power and remote control are always side opposite riser.

**DRAWING NUMBER 602d-PT-ITR-R-K
OCTOBER 2021**

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Whispertherm® Units with Top Connections - Side Risers - Unit Sizes 0204-0804

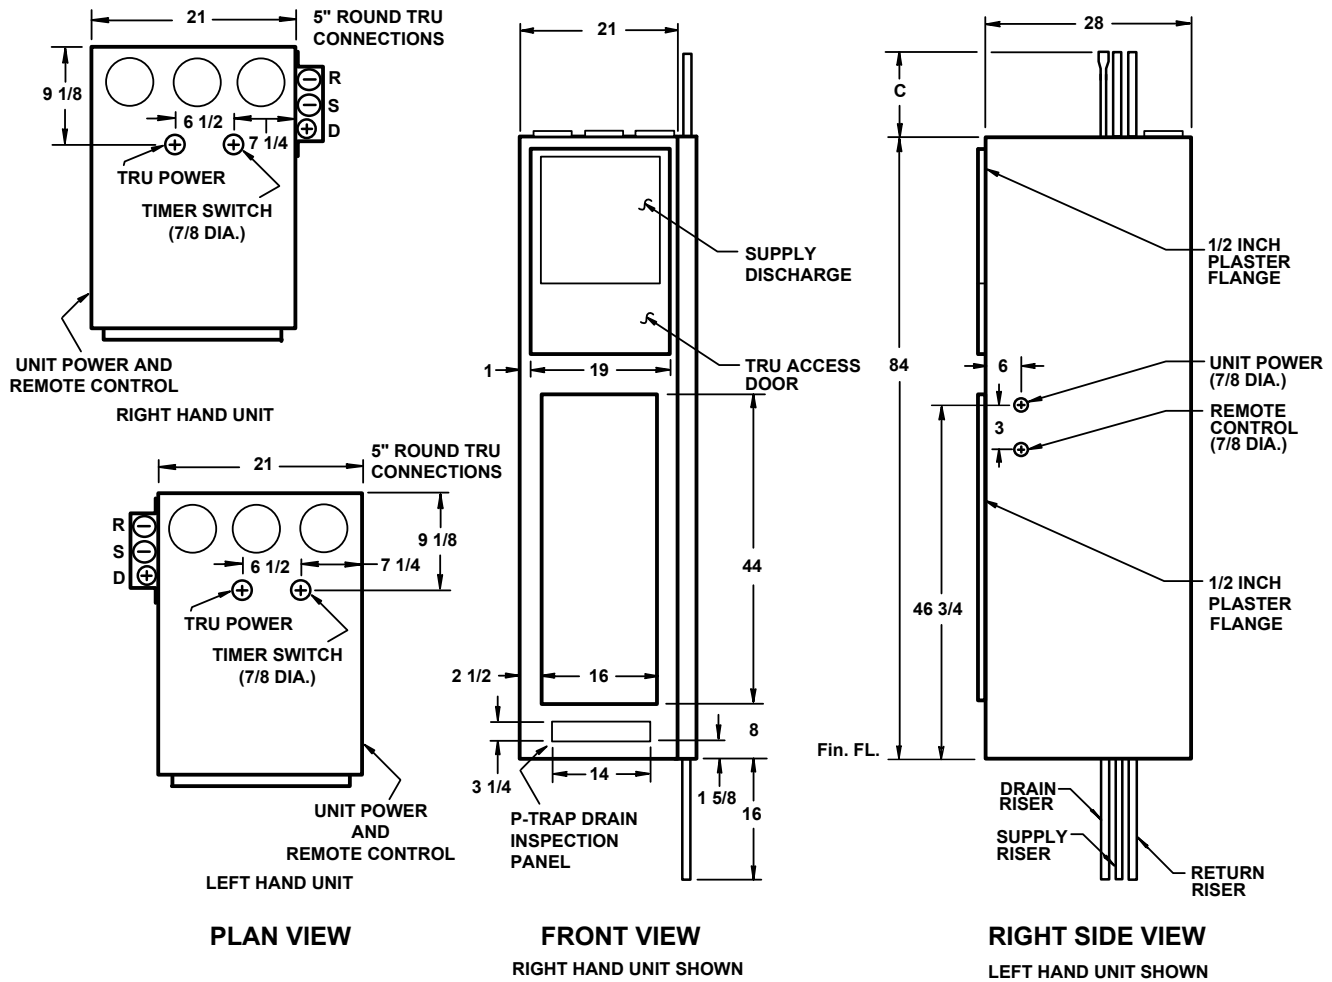

Notes:

1. The return air opening is always on the front of the unit.
2. Cabinet is acoustically and thermally insulated, and is fabricated of galvanized steel.
3. Supply, return and drain risers are type M copper. Riser assemblies include two shut off valves inside the cabinet. Standard units include high-pressure hose kits for connection of the refrigeration chassis or hydronic chassis.
4. See drawing 609-PT-ITR for plan view.
5. Fan motor is constant-torque ECM type. With no heat/cool demand, fan will operate constantly on Ultra Low speed.
6. TRU maximum exhaust = 162 CFM intermittent. TRU maximum ventilation = 95 CFM constant.
7. Side unit power and remote control are always side opposite riser.


RISER LENGTH	C
9 FOOT	8
10 FOOT	20

All dimensions in inches.

DRAWING NUMBER 602e-PT-ITR-S
OCTOBER 2021

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Whispertherm® Units with Top Connections - Side Risers - Unit Sizes 0814-1204

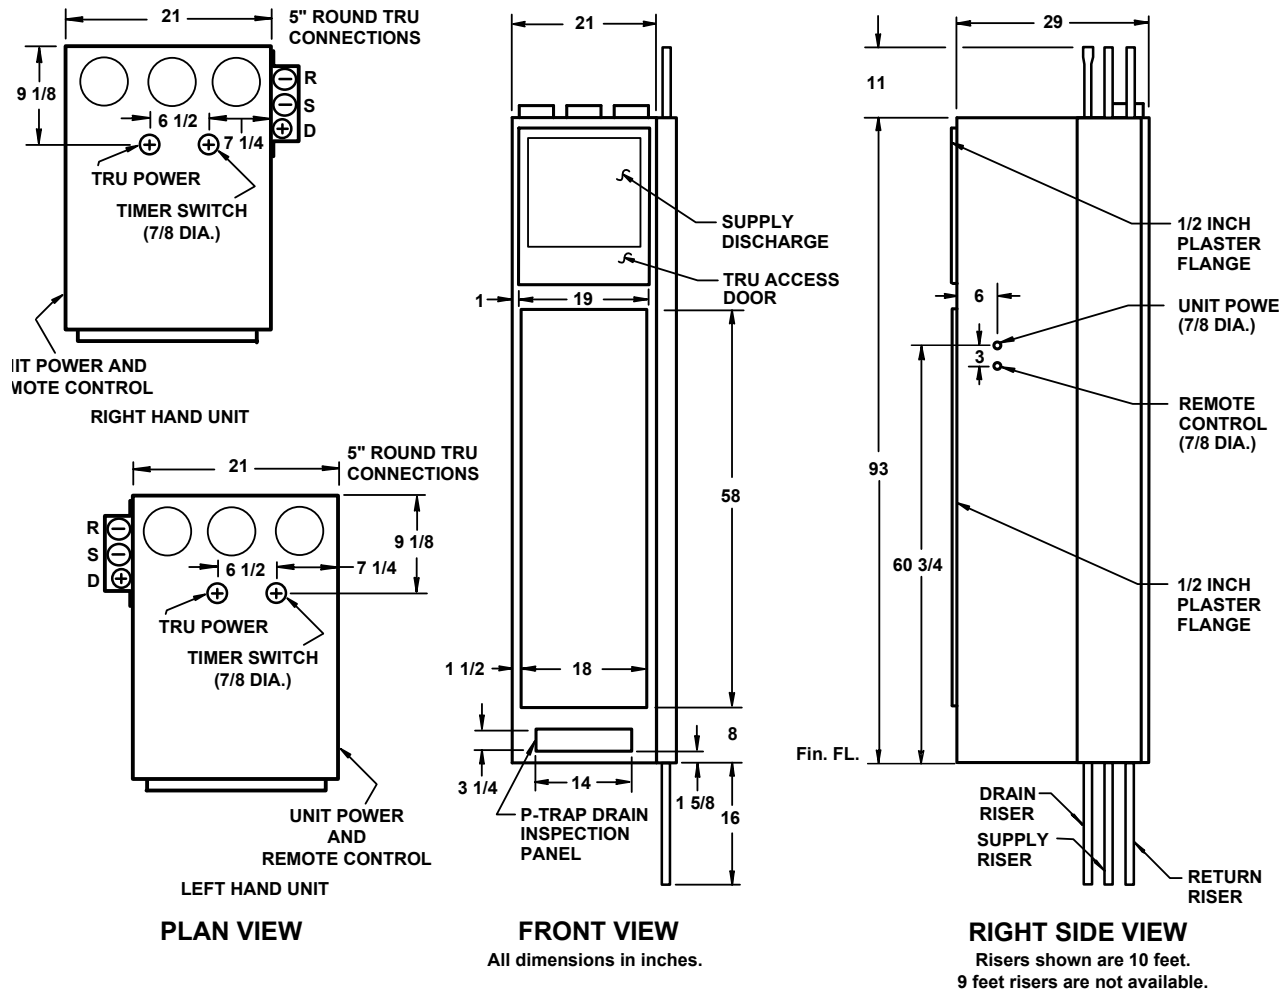

Notes:


1. The return air opening is always on the front of the unit.
2. Cabinet is acoustically and thermally insulated, and is fabricated of galvanized steel.
3. Supply, return and drain risers are type M copper. Riser assemblies include two shut off valves inside the cabinet. Standard units include high-pressure hose kits for connection of the refrigeration chassis or hydronic chassis.
4. See drawing 609-PT-ITR for plan view.
5. Fan motor is constant-torque ECM type. With no heat/cool demand, fan will operate constantly on Ultra Low speed.
6. TRU maximum exhaust = 162 CFM intermittent. TRU maximum ventilation = 95 CFM constant.
7. Side unit power and remote control are always side opposite riser.

**DRAWING NUMBER 602d-PT-ITR-S-K
OCTOBER 2021**

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Whispertherm® Units with Top Connections - Standard Risers by Others - Unit Sizes 0204-0804

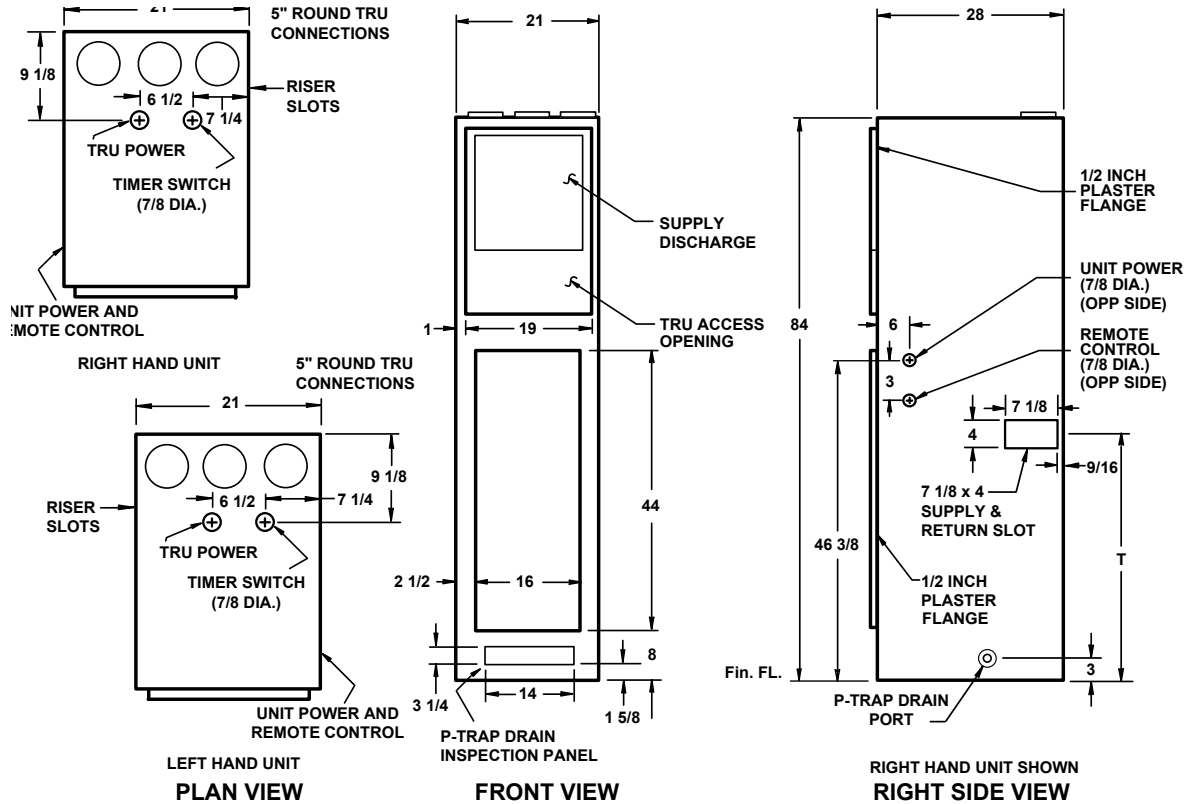


Notes:

1. The return air opening is always on the front of the unit.
2. Cabinet is acoustically and thermally insulated, and is fabricated of galvanized steel.
3. Supply, return and drain risers are installed by others. Hose kits and shutoff valves are shipped loose for field piping connection to refrigeration chassis or hydronic chassis.
4. See drawing 609-PT-ITR-STD for plan view.
5. Fan motor is constant-torque ECM type. With no heat/cool demand, fan will operate constantly on ultra Low speed.
6. TRU maximum exhaust = 162 CFM intermittent. TRU maximum ventilation = 95 CFM constant.
7. Side unit power and remote control are always side opposite riser. Rear unit power & remote control are located on the right side.


RISER HEIGHT	T
0204-**B	33
0304-**B	
0404-**B	
0504-**B	36
0604-**B	
0804-**B	

All dimensions in inches.

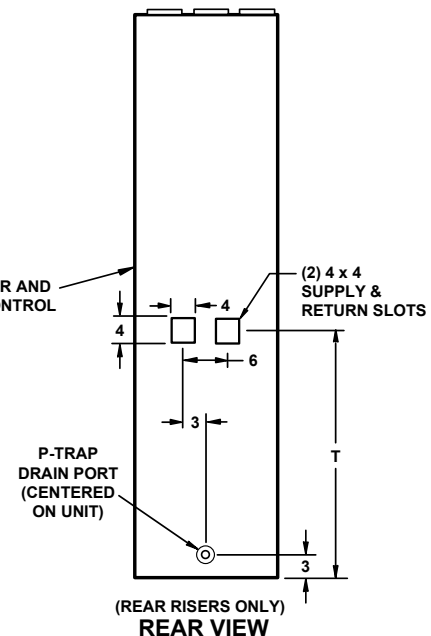


DRAWING NUMBER 602g-PT-ITR-NR-STD
OCTOBER 2021

Whispertherm® Units with Top Connections - Standard Risers by Others - Unit Sizes 0814-1204

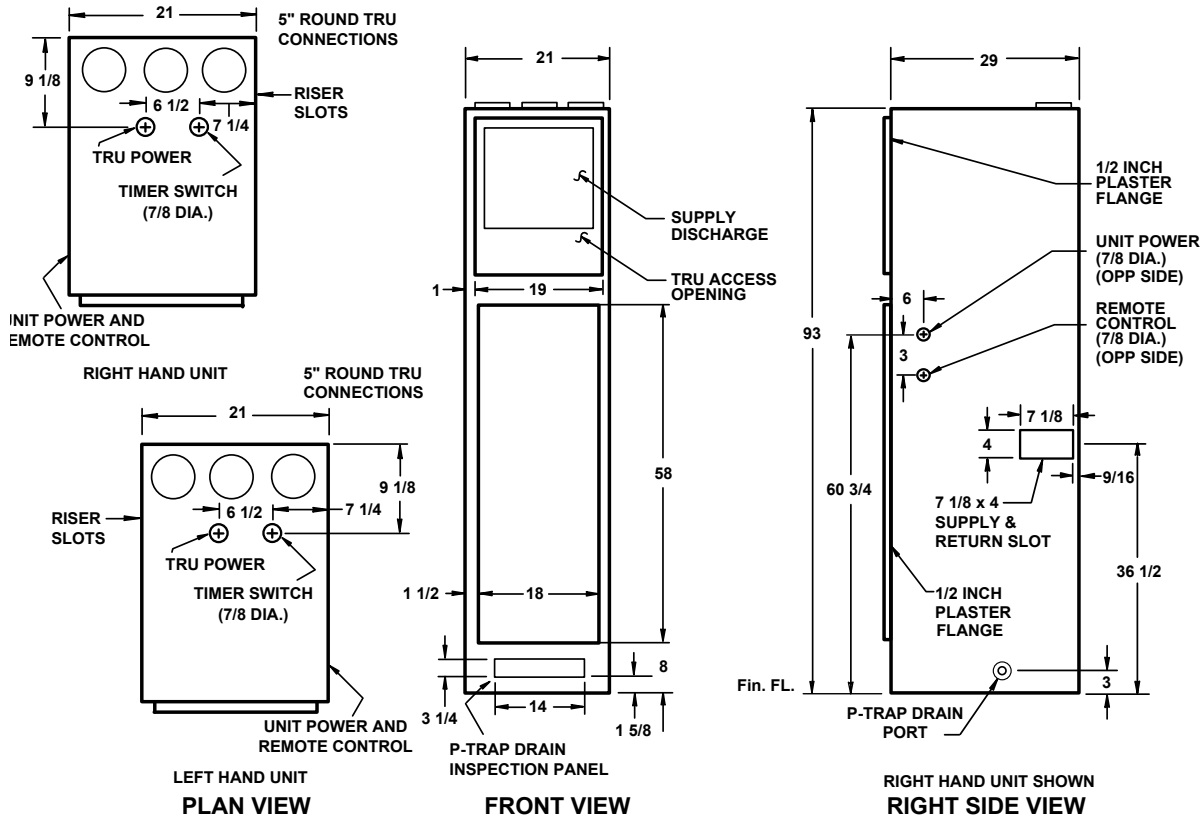

Notes:


1. The return air opening is always on the front of the unit.
2. Cabinet is acoustically and thermally insulated, and is fabricated of galvanized steel.
3. Supply, return and drain risers are installed by others. Hose kits and shutoff valves are shipped loose for field piping connection to refrigeration chassis or hydronic chassis.
4. See drawing 609-PT-ITR-STD for plan view.
5. Fan motor is constant-torque ECM type. With no heat/cool demand, fan will operate constantly on ultra Low speed.
6. TRU maximum exhaust = 162 CFM intermittent. TRU maximum ventilation = 95 CFM constant.
7. Side unit power and remote control are always side opposite riser. Rear unit power & remote control are located on the right side.

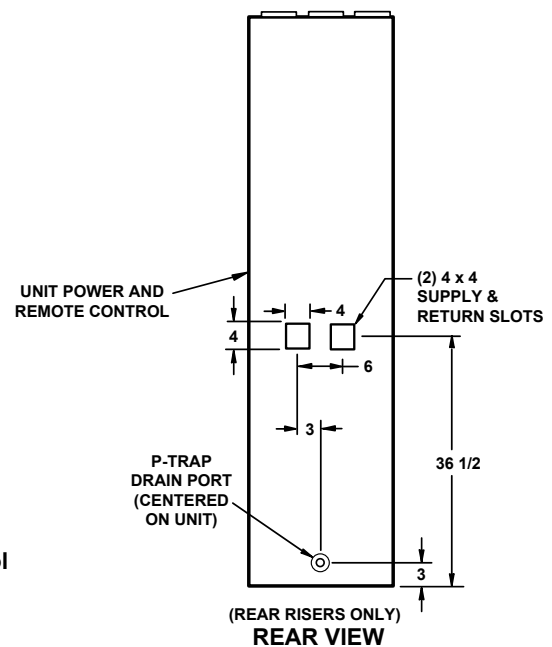

DRAWING NUMBER 602b-PT-ITR-NR-STD-K
OCTOBER 2021



Whispertherm® Units - Flush Mount Panel Installation (1 of 3)

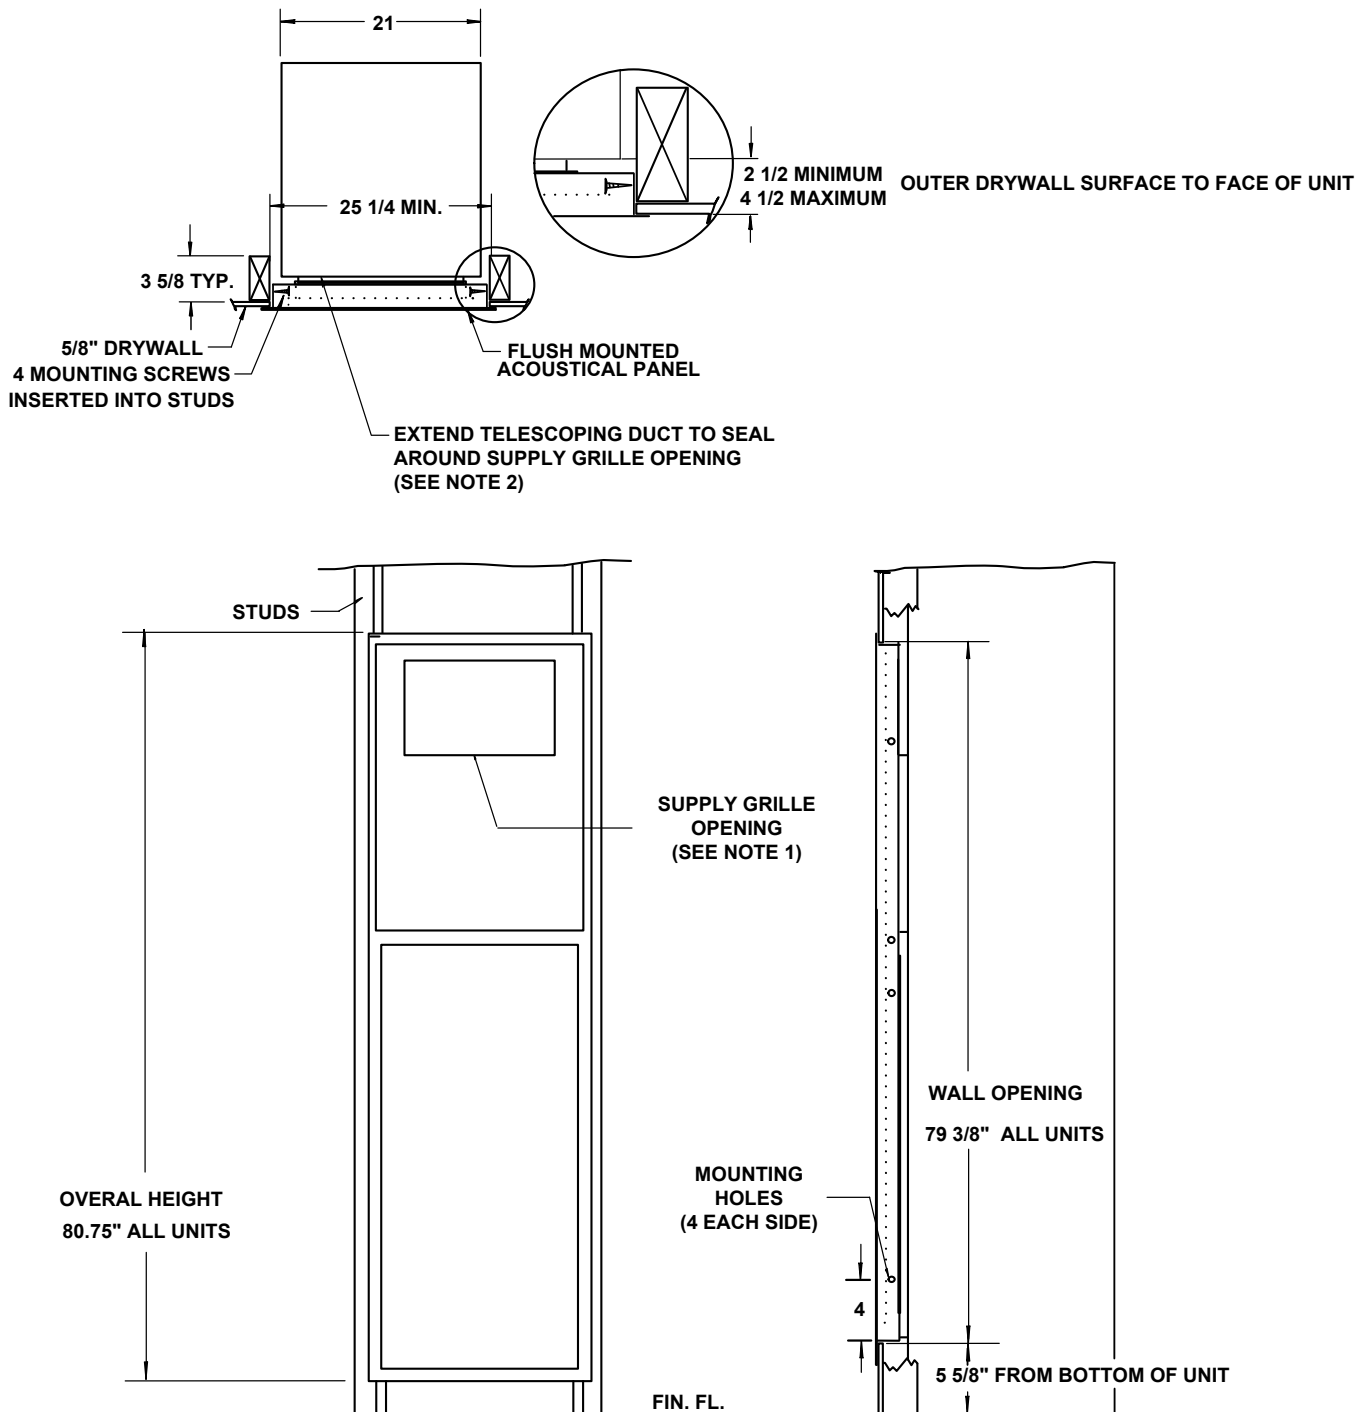


Notes:

1. Refer to drawing 611-ITR for supply types and sizes.
2. Telescoping duct is included on all cabinets with front supply.

DRAWING NUMBER: WAFPg-TR1 (1 of 3)

7 July, 2017

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

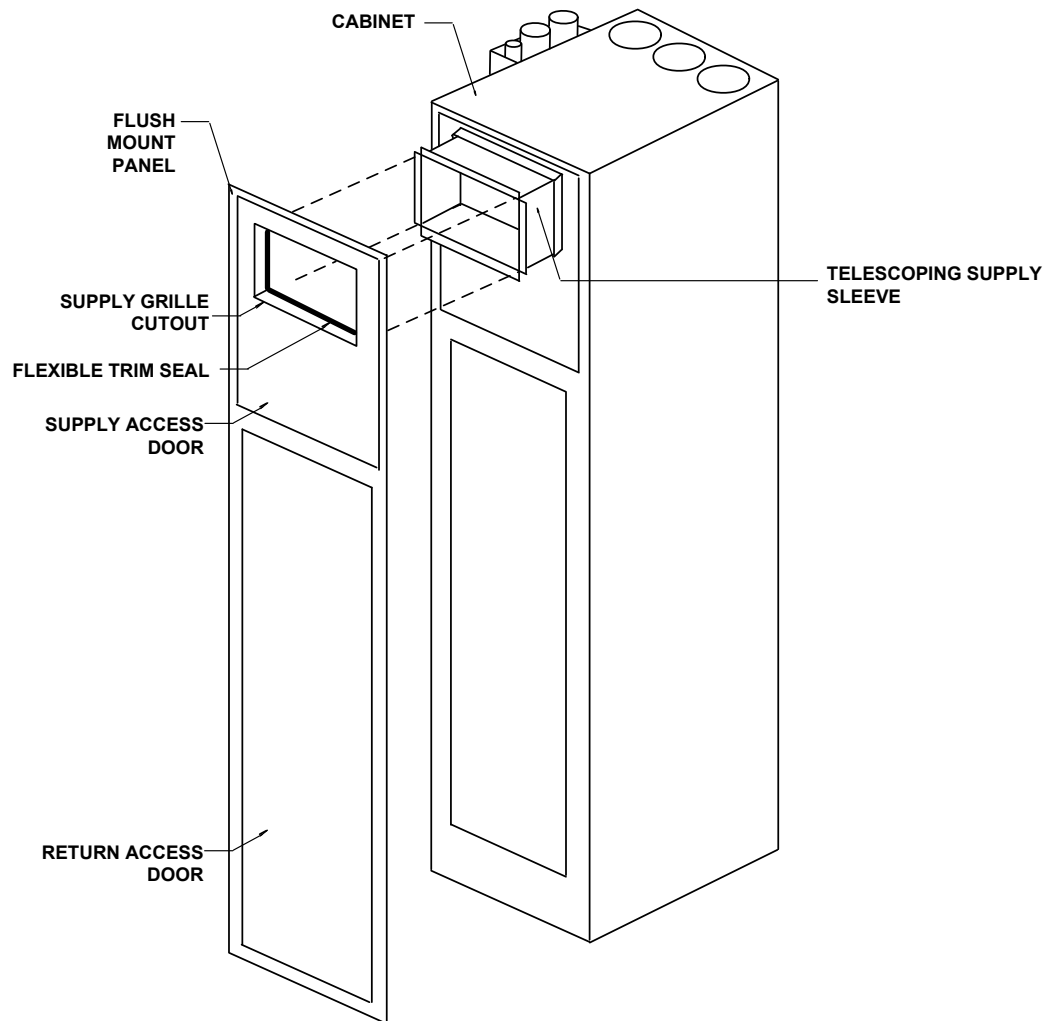
Notes:


1. Panel centered on unit.
2. Supply extension is adjustable and must butt up to the grille opening that creates a seal to avoid short cycling.

DRAWING NUMBER: WAFPg-TR2 (2 of 3)
7 July, 2017

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com



Whispertherm® Units - Flush Mount Panel Installation (3 of 3)

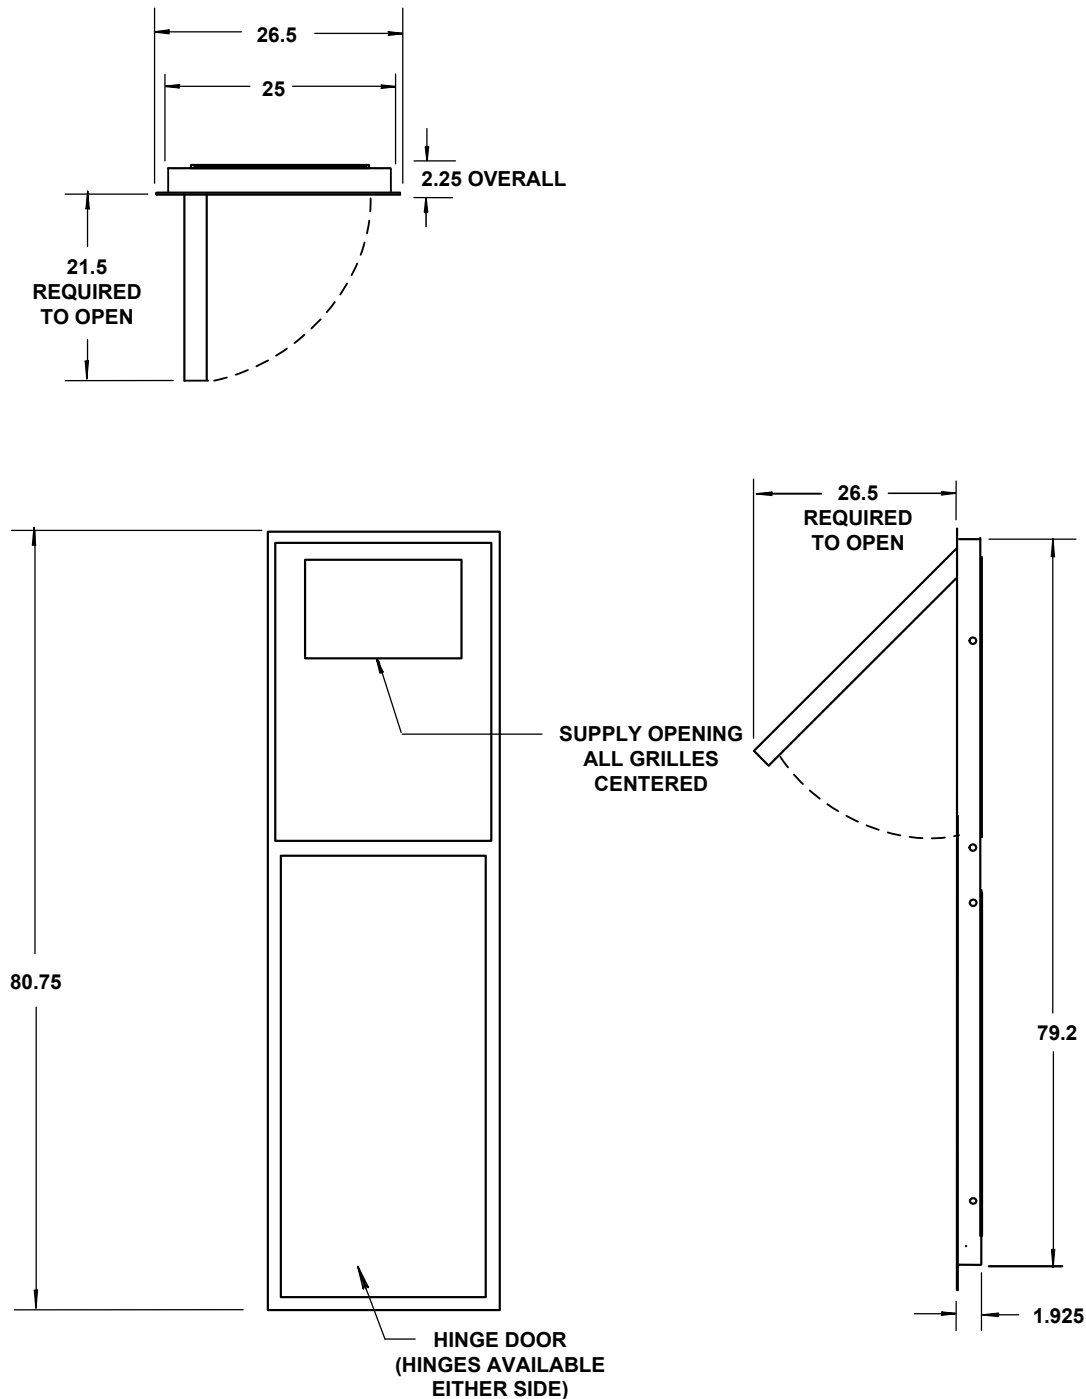

ALL DIMENSIONS IN INCHES

DRAWING NUMBER: WAFPg-TR3 (3 of 3)
7 July, 2017

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

Mechanical Specifications

Mechanical Specifications

WHISPERTHERM™ WATER SOURCE AIR CONDITIONER WITH THERMAL RECOVERY UNIT (TRU) AND HYDRONIC HEAT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Vertical Stack Water Source Air Conditioner with Hydronic Heat

1.02 RELATED SECTIONS

1.03 REFERENCES

- A. ETL Listed under Underwriters Laboratories Standard for Safety UL1995 for heat pumps.
- B. AHRI ISO Standard 13256-1

1.04 DELIVERY, STORAGE AND HANDLING

- A. Deliver products to site, store and protect from the weather and construction debris. Air conditioner cabinets and refrigeration chassis must be individually packaged and be tagged with site location, model number and configuration.

1.05 ENVIRONMENTAL REQUIREMENTS

- A. Protect units from construction debris by covering all openings prior to start-up of the equipment. Units must not be used for heating, cooling, or ventilation prior to the start-up of equipment for permanent use. Use of the equipment for the temporary heating, cooling or ventilation is prohibited.

1.06 FACTORY TESTING

- A. All units shall be factory tested at normal operating conditions. Cabinets and fans shall be tested to verify proper fan and control operation. Refrigeration chassis shall be factory tested with cataloged water flow rates and sequenced to verify the proper operation of safety controls. Testing without utilizing cataloged water flow rates is unacceptable. All factory risers shall be pressure tested for leaks.

1.07 SUBMITTAL DOCUMENTATION

- A. Standard submittals shall include capacities, drawings, electrical data, installation, operation and maintenance manuals and other details.

PART 2 PRODUCTS

2.01 TYPE

- A. Vertical Stack Water Source Air Conditioner with integral risers, hot water heating coil, discharge arrangements, hose kits, and all accessories (ADD SPECIFIC OPTIONS HERE). Units shall be standard operating range 75°F to 120°F (23.9°C to 48.9°C) entering fluid temperature for water source air conditioning applications.

2.02 CAPACITY

- A. Shall be as indicated on the drawings, which are based on Whalen units. Capacities shall be certified under AHRI ISO Standard 13256-1.

2.03 CABINETS

- A. The one-piece unit cabinet shall be fabricated of reinforced 22-gauge continuous G60 galvanized steel. All internal assemblies shall be welded and treated to prevent corrosion.
- B. The cabinet shall be insulated with 1/2-inch thick 2-pound density thermal and acoustical fiberglass insulation meeting material standard ASTM-C1071 and have an integral water repellent. The insulation shall have a fungi and bacteria resistant barrier with no growth conforming to ASTM-C1338, ASTM G21 and ASTM G22 and meet fire safety standards under NFPA90A and NFPA90B. (OPTION) 1-inch thick 1-1/2-pound density thermal and acoustical fiberglass insulated discharge plenum.
- C. The cabinet shall allow the placement of vertical risers on any side not being used for service access or discharge air openings.
- D. The cabinet will have slots with edge protectors to accommodate movement of the risers with the isolation valves affixed (see 2.05 B). The slots shall remain covered with insulation to minimize air infiltration.
- E. Cabinet return and discharge air openings shall be factory cut and flanged on all sides. All insulation located behind cabinet openings must be removed by the unit manufacturer prior to shipment.
- F. Cabinet design shall allow a minimum 5-inches below the chassis access opening to allow for full height baseboard.
- G. (OPTION) A factory installed vibration isolation pad shall be installed on the bottom of the unit.
- H. The air conditioner cabinets shall be shipped separately from, and prior to the refrigeration chassis for early installation at the jobsite.
- I. Cabinet design shall allow removal of the refrigeration chassis without a requirement to first remove the main fan or thermal recovery unit.
- J. Cabinet design shall allow removal of the thermal recovery unit without a requirement to first remove the chassis or main fan.
- K. Cabinet design shall include means to connect and seal the supply air opening to the Acoustical Air Panel mounted per Whalen instructions.
- L. Cabinet design shall offer ventilation air connections on its top. (OPTION 1) Alternate ventilation air connections available, on rear and/or one side, for air to and from the outdoors.

The Whalen Company works continually to improve its products. As a result, the design and specifications of each product at the time of order may be changed without notice and may not be as described herein. Please contact The Whalen Company's Customer Service Department at 1-410-822-9200 for specific information on the current design and specifications. Statements and other information contained herein are not express warranties and do not form the basis of any bargain between the parties, but are merely The Whalen Company's opinion or commendation of its products. The latest version of this document is available at whalencompany.com

- M. Cabinet design shall include internal channels to direct air from the exhaust air inlet connection, through the thermal recovery core, and to the exhaust air exit connection.
- N. Cabinet design shall include internal channels to direct air from the outdoor air inlet connection, through the thermal recovery core, and to the supply side of the chassis air coil.
- O. Cabinet design shall include internal channels to direct air from the outdoor air inlet connection, through the thermal recovery core, and through the unit filter prior to contact with the refrigeration system.

2.04 REFRIGERATION CHASSIS

- A. The refrigeration chassis consisting of the compressor, air coil, water coil, expansion device, receiver, filter-drier, hot water heating air coil and safety controls shall be slide-rail base mounted in the cabinet, and shall be designed for easy removal after disconnecting the two hoses and a polarized electrical power plug.
- B. The compressor shall be the sealed hermetic type approved and tested for reverse cycle operation. Internal thermal overload protection shall be provided. The compressor shall be internally isolated and externally hard rubber mounted to the floating chassis. Compressor motors shall be permanent split capacitor (PSC) type. The compressor shall not operate on a call for heating.
- C. The air coils shall be copper tubes mechanically bonded to aluminum fins, multi-circuited to insure maximum coil distribution and effectiveness, and a minimum of three rows deep. The coil shall be rated to withstand 600 psig refrigerant working pressure. Face velocity shall not exceed 400 feet per minute to insure quiet operation and positive condensate drainage.
- D. The water coils shall incorporate an electro-coated steel outer tube and a copper inner tube. The inner tube shall be spirally fluted and bonded to the outer tube to insure controlled refrigerant velocity and distribution. The coil shall be rated to withstand 650 psig refrigerant and 400 psig fluid working pressures. **(OPTION) Provide Cupro-nickel COAX coil.**
- E. The hot water heating air coil shall be copper tubes mechanically bonded to the aluminum fins, multi-circuited to insure maximum coil distribution and effectiveness and a minimum of two **(OPTION: three)** rows deep. Face velocity shall not exceed 400 feet per second to insure quiet operation. The refrigeration circuit shall not operate on a call for heating.
- F. A three-way, two-position (On/Off) electric control valve (30 psi differential pressure) shall be factory mounted and wired into the refrigeration chassis to divert fluid flow between the water to refrigerant coil and hot water heating air coil. **(OPTION) Provide two, two-way, two-position (On/Off) electric control valves (30 psi differential pressure) in lieu of a three-way control valve for variable flow systems. The valves shall factory mounted and wired into the refrigeration chassis to prevent fluid flow to the unit when a call for cooling or heating is not present.**
- G. **(OPTION) Automatic flow control valve – An automatic flow control valve shall be provided with each chassis and be factory preset for a fixed flow rate regardless of system pressure. Each automatic balancing valve shall be capable of operation over a pressure differential range of 2 to 80 PSID. Valves must utilize threaded connections and be easily removable for cleaning and maintenance.**
- H. The chassis shall be shipped separately from the WSHP cabinets to prevent exposure to, and fouling from finishing work.

2.05 RISERS

- A. The unit manufacturer shall furnish Type M **(OPTION: Type L)** copper supply and return condenser water risers as an integral factory-assembled component of the heat pump. Supply and return risers shall be protected by a galvanized steel pipe chase the length of the cabinet. **(OPTION) Provide (3/8) (1/2)-inch thick closed-cell riser insulation the length of the cabinet for ground-source applications.**
- B. Ball-type isolation valves shall be factory assembled on the risers by the heat pump manufacturer. The chassis shall be connected to the isolation valves through high-pressure stainless steel hoses provided by the unit manufacturer, to isolate compressor noise and vibration from the piping system. Connection of the refrigerant chassis to building water system through the use of unions is unacceptable.
- C. The unit manufacturer shall furnish the air conditioner cabinet with the supply and return risers connected together (short circuited) between the isolation valves to facilitate flushing by bypassing water directly into the return loop without the water passing thru any device in the unit (i.e. refrigeration chassis, automatic flow control valve).
- D. The condensate drain riser shall be Type M copper and insulated the length of the cabinet with 3/8-inch closed-cell insulation.

2.06 DRAIN PAN

- A. The drain pan shall collect and drain condensate that may form from any component internal to the heat pump and shall be fabricated of welded and soldered 20 Ga. 304 stainless steel. The copper condensate drain shall be rolled and soldered into the pan.

2.07 FANS

- A. The fan shall be slow speed forward curved centrifugal type capable of two fan speeds, and shall be accessible for removal and maintenance through the return air opening.

2.08 MOTORS

- A. Fan motors for heat pumps under 2-ton shall be of the permanently lubricated PSC standard or hi-static pressure **(OPTION: ECM)** type, as required; suitable for the current characteristics shown on the drawings, and shall have built-in thermal overload protection.
- B. Fan motors for heat pumps 2-ton and above shall be of the permanently lubricated constant-torque ECM **(OPTION: constant-volume ECM)** type, suitable for the current characteristics shown on the drawings, and shall have built-in overload protection.
- C. Motors shall be plug-in, multi-speed type with 1050-RPM maximum.
- D. **(OPTION) Provide a two-speed fan switch located behind the acoustic return air panel. The fan switch must be configurable for use with available fan speed motor taps.**

Mechanical Specifications

2.09 SUPPLY GRILLES

- A. (STANDARD) The supply grilles shall be of the single deflection type fabricated of clear anodized aluminum. All supply openings shall be painted black with a damper assembly and sight baffle provided when one unit is serving two separate rooms.

(OPTION 1) The supply grilles shall be of the single deflection type fabricated of (factory white painted extruded aluminum) or (custom painted extruded aluminum) (SELECT ONE). All supply openings shall be painted black with a damper assembly and sight baffle provided when one unit is serving two separate rooms.

(OPTION 2) The supply grilles shall be of the double deflection type fabricated of (clear anodized extruded aluminum), (factory white painted extruded aluminum) or (custom painted extruded aluminum) (SELECT ONE). All supply openings shall be painted black with a damper assembly and sight baffle provided when one unit is serving two separate rooms.

2.10 RETURN AIR PANEL

- A. (STANDARD) Unit Mounted Acoustical Panel - The return air opening shall be covered with a standard solid hinged front acoustical panel with return air entering through the bottom, top and both sides. The front panel shall be fabricated of etched galvanized steel painted appliance white. The return air panel shall allow for filter maintenance without the use of tools and be secured shut via magnets. The door opening shall be sized to allow direct removal of the cabinet inner panel and refrigeration chassis.
- B. The supply air section of the panel shall include a removable hinged door secured shut by magnets. The door opening shall be sized to allow either servicing or direct removal of the thermal recovery unit. The door shall house the supply air grille, sized per schedule.
- C. Standard supply air grille opening shall include snap-in style spring clip on each side to secure the supply air grille. Grilles shall be shipped with return air panel but NOT INSTALLED in the removable hinged door.

2.11 FILTERS

- B. (STANDARD) Filters shall be 1" thick disposable fiberglass media, MERV 4.

(OPTION 1) Filters shall be 1" thick disposable pleated media, MERV 8.

(OPTION 2) Filters shall be 1" thick disposable pleated media, MERV 13.

(OPTION 3) Filters shall be 1" thick permanent aluminum cleanable media, MERV 4.

2.12 THERMAL ENERGY RECOVERY SECTION / OUTDOOR AIR

- A. Cabinets shall be supplied with a thermal recovery unit that is easily accessible and removable for servicing. Duct connections for the thermal recovery unit shall be standard 5 inch diameter.
- B. The thermal recovery unit shall be fabricated from heavy-gauge galvanized steel. A ½ inch drain hose emptying into the cabinet drain pan shall be provided. A positive closing damper shall be included on the exhaust air discharge duct connection. Electrical connection for the module shall be made by a male plug into a female receptacle supplied in the cabinet.
- C. Air filters shall be supplied for the fresh air and exhaust air flows. Filters shall be easily serviced or replaced through the front of the unit. Filters shall be washable.
- D. The thermal recovery unit shall house fresh air and exhaust air blowers. Blowers shall be statically and dynamically balanced, direct drive, single phase with integral thermal overload protection. The blower wheel shall be the forward-curved SWSI centrifugal type.
- E. The fresh air and exhaust air blower speed shall be set at the factory.
- F. The thermal recovery core shall be protected by a defrost sensor that terminates operation of the fresh air blower.
- G. (OPTION 2) An optional timed washroom exhaust control with reset to be provided with decorative momentary switch to activate the exhaust fan for a maximum of 20 minutes.
- H. (OPTION 3) Factory set dedicated constant ventilation rate selection 1) 25 CFM 2) 35 CFM 3) 50 CFM 4) 70 CFM 5) 90 CFM.
- I. (OPTION 4) Factory set nominal intermittent exhaust rate high speed selection 1) 100 CFM 2) 150 CFM when used in conjunction with optional timed momentary switch.

2.13 POWER SUPPLY

- A. Single point field power connection is made to unit junction box through either of the 7/8" knockouts located on the side or on the top of the cabinet as shown on the drawings.



(OPTION 1) Each unit shall include a non-fused disconnect switch, factory mounted and wired.

(OPTION 2) Each unit shall include a fused disconnect switch, factory mounted and wired.

2.14 CONTROLS

- A. Unit shall include a solid-state control board as part of the unit control system incorporating these features:
 - a. Random start compressor protection.
 - b. Anti-short cycle compressor minimum OFF time delay.
 - c. Safety controls that protect the compressor from the following conditions:
 - i. High pressure
 - ii. Low airflow
 - iii. Low liquid flow
 - iv. Low entering air temperature
 - v. Brown-out power conditions
 - vi. Condensate Overflow Protection
 - d. Status LED indicating the device causing a fault condition.
 - e. Soft lockout feature that provides for an automatic reset prior to the initiation of a hard lockout.
 - f. Test mode capability with shortened time delays for servicing.
 - g. (OPTION 1) Low pressure
 - h. (OPTION 2) Low/High liquid temperature protection with three different settings based on liquid properties.
- B. The unit shall default to continuous ultra-low main fan speed if no call for Heating or Cooling.
- C. The thermal recovery unit shall have independent dedicated electrical power and both blowers shall operate continuously.
- D. (OPTION 1) Factory set dedicated constant ventilation rate selection 1) 25 CFM 2) 35 CFM 3) 50 CFM 4) 70 CFM 5) 90 CFM.
- E. (OPTION 2) Timed washroom exhaust control with reset to activate 100 CFM intermittent exhaust high fan speed for a maximum of 20 minutes. Factory set dedicated constant ventilation rate selection 1) 25 CFM 2) 35 CFM 3) 50 CFM 4) 70 CFM. (Decorative switches must be purchased separately. Multiple switches may be used for a single unit.)
- F. (OPTION 3) Timed washroom exhaust control with reset to activate 150 CFM intermittent exhaust high fan speed for a maximum of 20 minutes. Factory set dedicated constant ventilation rate selection 1) 35 CFM 2) 50 CFM 3) 70 CFM 4) 90 CFM. (Decorative switches must be purchased separately. Multiple switches may be used for a single unit.)

2.15 THERMOSTAT

- A. The heat pump manufacturer shall provide a 24-volt manual changeover wall thermostat with a HEAT-OFF-COOL system switch and AUTO-ON fan selector switch.
- B. On units up to two tons of cooling, the thermostat shall be unit mounted at a height of 48 inches from the bottom of the cabinet. On units greater than two tons of cooling, the thermostat shall be remote mounted.
- C. Others shall install thermostat by plugging into the control wiring with a polarized male-female plug after the walls are finished when unit mounted or attaching to color coded pigtailed when remote mounted. High voltage, return air thermostats with remote bulbs subject to damage during routine service will not be accepted.

2.16 SPARE PARTS

- A. The installing contractor shall provide to the Owner one spare chassis for each fifty heat pumps of a given size. (Add any additional spare parts requirements here).

PART 3 EXECUTION

3.01 INSTALLATION

- A. Furnish as shown on the drawings and as specified herein, vertical stack water source heat pumps with integral risers, and with capacity and electrical characteristics as scheduled. Units shall be Series VI as manufactured by The Whalen Company of Easton, MD.
- B. Install in accordance with manufacturer's installation instructions. Install units plumb and level, and maintain manufacturer's recommended clearances for the unit and accessories.
- C. Follow manufacturer's recommendations for cleaning and flushing.




The Whalen Company Limited Express Warranty Water-to-Air Heat Pump Standard Warranty

The Whalen Company warrants to the purchaser each water-to-air heat pump to be free from original defects in materials and workmanship.

Where inspection by an authorized representative of The Whalen Company confirms such defects to be present, for a period of eighteen months from date of shipment, Whalen will furnish replacement components or materials to the original purchaser without charge.

This Limited Express Warranty is intended to cover original equipment defects only and does not cover or apply to: (1) Air filters, refrigerant, fluids, oil; (2) Equipment relocated after initial installation; (3) Any portion or component of any system that is not supplied by The Whalen Company, regardless of the cause of the failure of such portion or component; (4) Equipment on which the unit identification tags or labels have been removed or modified; (5) Equipment which have defects or damage which result from improper installation, wiring, electrical imbalance characteristics or maintenance; or are caused by accident, misuse or abuse, fire, flood, acts of God, alteration or misapplication of the product; (6) Equipment used as temporary heating or cooling while the facility is still under construction is considered misuse and as such, will void all warranty coverage regardless of the cause of failure; (7) Equipment which have defects or damage which result from a contaminated or corrosive air or liquid supply, operation at abnormal temperatures, or unauthorized opening of refrigerant circuit; (8) Mold, fungus or bacteria damages; (9) Equipment subjected to corrosion or abrasion; (10) Equipment manufactured or supplied by others; (11) Equipment which have been operated in any manner contrary to The Whalen Company printed instructions; or (12) Equipment which have defects, damage or insufficient performance as a result of insufficient or incorrect system design or the improper application of The Whalen Company products.

The Whalen Company neither assumes nor authorizes any person to assume for it any obligation or warranty other than those stated herein.

This Limited Express Warranty does not cover labor charges associated with making repairs, inspection and diagnosis of malfunctions, all field labor in connection with repair or replacement of parts, all field labor in connection with removal and transportation to and from a repair facility and all field labor in connection with reinstallation after repairs are completed. However, The Whalen Company at its sole discretion may provide a labor allowance in cases of DOA (Dead on Arrival) equipment for replacement or repair of defective components within 30-days of start-up or 90-days from factory shipment, whichever comes first. After this period only the Limited Express Warranty will apply. Labor will be paid per The Whalen Company Warranty Labor Allowance schedule.

Replacement or repair under this warranty will not extend the warranty time periods defined above.
Whalen shall not, in any event, have any liability under this warranty unless and until it has been paid in full for the equipment supplied. The warranty period shall commence on the date of shipment, however, whether or not payment has been made.

This warranty applies only to Whalen heat pump installations in the fifty United States and in Canada. There are no warranties outside those areas.

The Whalen Company has no liability for incidental or consequential damages arising out of the ownership, use, or operation of Whalen heat pumps.

THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. NO IMPLIED WARRANTY OR MERCHANTABILITY SHALL ACCOMPANY THE SALE OF THIS EQUIPMENT, AND THIS EXPRESS WARRANTY IS INTENDED TO AND DOES REPLACE ANY IMPLIED WARRANTY OF MERCHANTABILITY.

This warranty, its limitations and its exclusions are to be governed by the laws of Maryland. Although some warranties may vary in their effect and coverage from locality to locality, this warranty, its effects, coverage and remedies are only those available in Maryland.

Rev: 12/2020



**The Whalen Company
Limited Express Warranty
Water-to-Air Heat Pump Chassis Standard Warranty**

The Whalen Company warrants to the purchaser each water-to-air heat pump chassis (or each refrigeration chassis) to be free from original defects in materials and workmanship.

Where inspection by an authorized representative of The Whalen Company confirms such defects to be present, for a period of twelve months from date of shipment, Whalen will furnish replacement components or materials to the original purchaser without charge.

This Limited Express Warranty is intended to cover original equipment defects only and does not cover or apply to: (1) Air filters, refrigerant, fluids, oil; (2) Equipment relocated after initial installation; (3) Any portion or component of any system that is not supplied by The Whalen Company, regardless of the cause of the failure of such portion or component; (4) Equipment on which the unit identification tags or labels have been removed or modified; (5) Equipment which have defects or damage which result from improper installation, wiring, electrical imbalance characteristics or maintenance, or are caused by accident, misuse or abuse, fire, flood, acts of God, alteration or misapplication of the product; (6) Equipment used as temporary heating or cooling while the facility is still under construction is considered misuse and as such, will void all warranty coverage regardless of the cause of failure; (7) Equipment which have defects or damage which result from a contaminated or corrosive air or liquid supply, operation at abnormal temperatures, or unauthorized opening of refrigerant circuit; (8) Mold, fungus or bacteria damages; (9) Equipment subjected to corrosion or abrasion; (10) Equipment manufactured or supplied by others; (11) Equipment which have been operated in any manner contrary to The Whalen Company printed instructions; or (12) Equipment which have defects, damage or insufficient performance as a result of insufficient or incorrect system design or the improper application of The Whalen Company products.

The Whalen Company neither assumes nor authorizes any person to assume for it any obligation or warranty other than those stated herein.

This Limited Express Warranty does not cover labor charges associated with making repairs, inspection and diagnosis of malfunctions, all field labor in connection with repair or replacement of parts, all field labor in connection with removal and transportation to and from a repair facility and all field labor in connection with reinstallation after repairs are completed. However, The Whalen Company at its sole discretion may provide a labor allowance in cases of DOA (Dead on Arrival) equipment for replacement or repair of defective components within 30-days of start-up or 90-days from factory shipment, whichever comes first. After this period only the Limited Express Warranty will apply. Labor will be paid per The Whalen Company Warranty Labor Allowance schedule.

Replacement or repair under this warranty will not extend the warranty time periods defined above.
Whalen shall not, in any event, have any liability under this warranty unless and until it has been paid in full for the equipment supplied. The warranty period shall commence on the date of shipment, however, whether or not payment has been made.


This warranty applies only to Whalen heat pump installations in the fifty United States and in Canada. There are no warranties outside those areas.

The Whalen Company has no liability for incidental or consequential damages arising out of the ownership, use, or operation of Whalen heat pumps.

THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. NO IMPLIED WARRANTY OR MERCHANTABILITY SHALL ACCOMPANY THE SALE OF THIS EQUIPMENT, AND THIS EXPRESS WARRANTY IS INTENDED TO AND DOES REPLACE ANY IMPLIED WARRANTY OF MERCHANTABILITY.

This warranty, its limitations and its exclusions are to be governed by the laws of Maryland. Although some warranties may vary in their effect and coverage from locality to locality, this warranty, its effects, coverage and remedies are only those available in Maryland.

Rev: 12/2020



**The Whalen Company
Limited Express Warranty
Water-to-Air Heat Pump with 5 Year Compressor Warranty**

The Whalen Company warrants to the purchaser each water-to-air heat pump to be free from original defects in materials and workmanship.

Where inspection by an authorized representative of The Whalen Company confirms such defects to be present, for a period of eighteen months from date of shipment, Whalen will furnish replacement components or materials to the original purchaser without charge.

In addition, for a period of sixty months from date of shipment, Whalen will furnish a replacement for any compressor found by an authorized representative of The Whalen Company to contain an original defect.

This Limited Express Warranty is intended to cover original equipment defects only and does not cover or apply to: (1) Air filters, refrigerant, fluids, oil; (2) Equipment relocated after initial installation; (3) Any portion or component of any system that is not supplied by The Whalen Company, regardless of the cause of the failure of such portion or component; (4) Equipment on which the unit identification tags or labels have been removed or modified; (5) Equipment which have defects or damage which result from improper installation, wiring, electrical imbalance characteristics or maintenance; or are caused by accident, misuse or abuse, fire, flood, acts of God, alteration or misapplication of the product; (6) Equipment used as temporary heating or cooling while the facility is still under construction is considered misuse and as such, will void all warranty coverage regardless of the cause of failure; (7) Equipment which have defects or damage which result from a contaminated or corrosive air or liquid supply, operation at abnormal temperatures, or unauthorized opening of refrigerant circuit; (8) Mold, fungus or bacteria damages; (9) Equipment subjected to corrosion or abrasion; (10) Equipment manufactured or supplied by others; (11) Equipment which have been operated in any manner contrary to The Whalen Company printed instructions; or (12) Equipment which have defects, damage or insufficient performance as a result of insufficient or incorrect system design or the improper application of The Whalen Company products.

The Whalen Company neither assumes nor authorizes any person to assume for it any obligation or warranty other than those stated herein.

This Limited Express Warranty does not cover labor charges associated with making repairs, inspection and diagnosis of malfunctions, all field labor in connection with repair or replacement of parts, all field labor in connection with removal and transportation to and from a repair facility and all field labor in connection with reinstallation after repairs are completed. However, The Whalen Company at its sole discretion may provide a labor allowance in cases of DOA (Dead on Arrival) equipment for replacement or repair of defective components within 30-days of start-up or 90-days from factory shipment, whichever comes first. After this period only the Limited Express Warranty will apply. Labor will be paid per The Whalen Company Warranty Labor Allowance schedule.

Replacement or repair under this warranty will not extend the warranty time periods defined above. Whalen shall not, in any event, have any liability under this warranty unless and until it has been paid in full for the equipment supplied. The warranty period shall commence on the date of shipment, however, whether or not payment has been made.

This warranty applies only to Whalen heat pump installations in the fifty United States and in Canada. There are no warranties outside those areas.

The Whalen Company has no liability for incidental or consequential damages arising out of the ownership, use, or operation of Whalen heat pumps.

THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. NO IMPLIED WARRANTY OR MERCHANTABILITY SHALL ACCOMPANY THE SALE OF THIS EQUIPMENT, AND THIS EXPRESS WARRANTY IS INTENDED TO AND DOES REPLACE ANY IMPLIED WARRANTY OF MERCHANTABILITY.

This warranty, its limitations and its exclusions are to be governed by the laws of Maryland. Although some warranties may vary in their effect and coverage from locality to locality, this warranty, its effects, coverage, and remedies are only those available in Maryland.

Rev: 12/2020



The Whalen Company Limited Express Warranty Water-to-Air Heat Pump with 5 Year Refrigeration Circuit Warranty

The Whalen Company warrants to the purchaser each water-to-air heat pump to be free from original defects in materials and workmanship.

Where inspection by an authorized representative of The Whalen Company confirms such defects to be present, for a period of eighteen months from date of shipment, Whalen will furnish replacement components or materials to the original purchaser without charge.

In addition, for a period of sixty months from the date of shipment, Whalen will repair or replace refrigeration circuit components found by an authorized representative of The Whalen Company to contain an original defect. Refrigeration circuit components are defined to include the compressor, reversing valve, water coil, air coil, expansion device and interconnecting tubing only.

This Limited Express Warranty is intended to cover original equipment defects only and does not cover or apply to: (1) Air filters, refrigerant, fluids, oil; (2) Equipment relocated after initial installation; (3) Any portion or component of any system that is not supplied by The Whalen Company, regardless of the cause of the failure of such portion or component; (4) Equipment on which the unit identification tags or labels have been removed or modified; (5) Equipment which have defects or damage which result from improper installation, wiring, electrical imbalance characteristics or maintenance; or are caused by accident, misuse or abuse, fire, flood, acts of God, alteration or misapplication of the product; (6) Equipment used as temporary heating or cooling while the facility is still under construction is considered misuse and as such, will void all warranty coverage regardless of the cause of failure; (7) Equipment which have defects or damage which result from a contaminated or corrosive air or liquid supply, operation at abnormal temperatures, or unauthorized opening of refrigerant circuit; (8) Mold, fungus or bacteria damages; (9) Equipment subjected to corrosion or abrasion; (10) Equipment manufactured or supplied by others; (11) Equipment which have been operated in any manner contrary to The Whalen Company printed instructions; or (12) Equipment which have defects, damage or insufficient performance as a result of insufficient or incorrect system design or the improper application of The Whalen Company products

The Whalen Company neither assumes nor authorizes any person to assume for it any obligation or warranty other than those stated herein.

This Limited Express Warranty does not cover labor charges associated with making repairs, inspection and diagnosis of malfunctions, all field labor in connection with repair or replacement of parts, all field labor in connection with removal and transportation to and from a repair facility and all field labor in connection with reinstallation after repairs are completed. However, The Whalen Company at its sole discretion may provide a labor allowance in cases of DOA (Dead on Arrival) equipment for replacement or repair of defective components within 30-days of start-up or 90-days from factory shipment, whichever comes first. After this period only the Limited Express Warranty will apply. Labor will be paid per The Whalen Company Warranty Labor Allowance schedule

Replacement or repair under this warranty will not extend the warranty time periods defined above. Whalen shall not, in any event, have any liability under this warranty unless and until it has been paid in full for the equipment supplied. The warranty period shall commence on the date of shipment, however, whether or not payment has been made.

This warranty applies only to Whalen heat pump installations in the fifty United States and in Canada. There are no warranties outside those areas.

The Whalen Company has no liability for incidental or consequential damages arising out of the ownership, use, or operation of Whalen heat pumps.

THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. NO IMPLIED WARRANTY OR MERCHANTABILITY SHALL ACCOMPANY THE SALE OF THIS EQUIPMENT, AND THIS EXPRESS WARRANTY IS INTENDED TO AND DOES REPLACE ANY IMPLIED WARRANTY OF MERCHANTABILITY.

This warranty, its limitations and its exclusions are to be governed by the laws of Maryland. Although some warranties may vary in their effect and coverage from locality to locality, this warranty, its effects, coverage, and remedies are only those available in Maryland.

Rev: 12/2020

Revision Table

Date	Description
02/11/2021	Updated Warranty Statements
06/23/2020	Updated Cabinet Drawings
08/8/2019	Updated Cabinet Drawings
11/17/2017	Whispertherm® Performance Table Added
10/10/2017	Wire Drawings, Riser Drawings, and Cabinet Drawings Updated
09/05/2017	Riser Drawings Updated
07/18/2017	New Release of document



8900 Glebe Park Drive
Easton, MD 21601
Tel, 410.822.9200 • 410.822.8926
whalencompany.com



Whispertherm® and Whisperpack® are trademarks of The Whalen Company. © Whalen Company. All rights reserved.

